Y3 N33 25/4405

NUREG/CR-4405
BNL-NUREG-51931

Probabilistic Risk Assessment (PRA) Insights

Prepared by R. Fitzpatrick, L. Arrieta, T. Teichmann, P. Davis

Brookhaven National Laboratory

Prepared for
U.S. Nuclear Regulatory
Commission

NOTICE

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, or any of their employees, makes any warranty, expressed or implied, or assumes any legal liability of responsibility for any third party's use, or the results of such use, of any information, apparatus, product or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.

NOTICE

Availability of Reference Materials Cited in NRC Publications

Most documents cited in NRC publications will be available from one of the following sources:

1. The NRC Public Document Room, 1717 H Street, N.W.
   Washington, DC 20555
2. The Superintendent of Documents, U.S. Government Printing Office, Post Office Box 37082
   Washington, DC 20013-7082
3. The National Technical Information Service, Springfield, VA 22161

Although the listing that follows represents the majority of documents cited in NRC publications, it is not intended to be exhaustive.

Referenced documents available for inspection and copying for a fee from the NRC Public Document Room include NRC correspondence and internal NRC memoranda; NRC Office of Inspection and Enforcement bulletins, circulars, information notices, inspection and investigation notices; Licensee Event Reports; vendor reports and correspondence; Commission papers; and applicant and licensee documents and correspondence.

The following documents in the NUREG series are available for purchase from the GPO Sales Program: formal NRC staff and contractor reports, NRC-sponsored conference proceedings, and NRC booklets and brochures. Also available are Regulatory Guides, NRC regulations in the *Code of Federal Regulations*, and *Nuclear Regulatory Commission Issuances*.

Documents available from the National Technical Information Service include NUREG-series reports and technical reports prepared by other federal agencies and reports prepared by the Atomic Energy Commission, forerunner agency to the Nuclear Regulatory Commission.

Documents available from public and special technical libraries include all open literature items, such as books, journal and periodical articles, and transactions. *Federal Register* notices, federal and state legislation, and congressional reports can usually be obtained from these libraries.

Documents such as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings are available for purchase from the organization sponsoring the publication cited.

Single copies of NRC draft reports are available free, to the extent of supply, upon written request to the Division of Information Support Services, Distribution Section, U.S. Nuclear Regulatory Commission, Washington, DC 20555.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at the NRC Library, 7920 Norfolk Avenue, Bethesda, Maryland, and are available there for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from the American National Standards Institute, 1430 Broadway, New York, NY 10018.

NUREG/CR-4405
BNL-NUREG-51931

Probabilistic Risk Assessment (PRA) Insights

Manuscript Completed: April 1986
Date Published: December 1987

Prepared by
R. Fitzpatrick, L. Arrieta, T. Teichmann, P. Davis*

Brookhaven National Laboratory
Upton, NY 11973

*Intermountain Technologies, Inc.

Prepared for
Division of Safety Review and Oversight
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555
NRC FIN A3796

ABSTRACT

Four different probabilistic risk assessments (PRAs) have been briefly reviewed with the broad objective of ascertaining what insights might be gained (beyond those already documented in the PRAs) by an independent evaluation. This effort was not intended to verify the specific details and results of each PRA but rather, having accepted the results, to see what they might mean on a plant-specific and/or generic level. The four PRAs evaluated were those for Millstone 3, Seabrook, Shoreham, and Oconee 3. Full detailed reviews of each of these four PRAs have been commissioned by the NRC, but only two have been completed and available as further input to this study: the review of Millstone 3 by LLNL and the review of Shoreham by BNL.

The review reported here focused on identifying the dominant (leading) initiators, failure modes, plant systems, and specific components that affect the overall core melt probability and/or risk to the public. In addition, the various elements of the methodologies employed by the four PRAs are discussed and ranked (per NUREG/CR-3852). PRA-specific insights are presented within the report section addressing that PRA, and overall insights are presented in the Summary.

BLANK PAGE

TABLE OF CONTENTS

		Page	
ABSTRACT		iii	
LIST OF FIGURES		vii	
LIST OF TABLES		viii	
ACKNOWLEDGMENTS		xi	
EXECUTIVE SUMMARY		xiii	
INTRODUCTION		1	
1. INSIGHTS FROM THE MILLSTONE 3 PROBABILISTIC SAFETY STUDY		1-1	
1.1 Introduction		1-1	3
1.2 Internal Events		1-1	3
1.2.1 Overall Results		1-1	3
1.2.2 Dominant Sequences		1-5	7
1.2.3 Initiating Events		1-5	7
1.2.4 System and Component Failures and Failure Modes		1-5	7
1.3 External Events		1-22	24
References		1-27	29
2. INSIGHTS FROM THE SEABROOK STATION PROBABILISTIC SAFETY ASSESSMENT		2-1	30
2.1 Introduction		2-1	30
2.2 Internal Events		2-1	30
2.2.1 Overall Results		2-1	30
2.2.2 Dominant Sequences		2-1	30
2.2.3 Initiating Events		2-6	35
2.2.4 System and Component Failures and Failure Modes		2-6	35
2.3 External Events		2-21	50
References		2-24	53
3. INSIGHTS FROM THE SHOREHAM PROBABILISTIC RISK ASSESSMENT		3-1	54
3.1 Introduction		3-1	54
3.2 Internal Events		3-1	54
3.2.1 Overall Results		3-1	54
3.2.2 Dominant Sequences		3-5	58
3.2.3 Initiating Events		3-5	58
3.2.4 System and Component Failures and Failure Modes		3-5	58
3.3 Risk		3-22	75
References		3-22	75
4. INSIGHTS FROM THE OCONEE 3 PROBABILISTIC RISK ASSESSMENT		4-1	79
4.1 Introduction		4-1	79
4.2 Internal Events		4-1	79
4.2.1 Overall Results		4-1	79
4.2.2 Dominant Sequences		4-4	82
4.2.3 Initiating Events		4-4	82
4.2.4 System and Component Failures and Failure Modes		4-4	82

		Page	
4.3	External Events	4-12	90
4.4	Risk	4-20	98
References		4-20	98
5.	DISCUSSION AND RANKING OF THE VARIOUS ELEMENTS OF THE METHODOLOGIES.	5-1	103
5.1	Introduction	5-1	103
5.2	Discussion of the Elements of the Methodologies	5-1	103
5.2.1	Identification of Initiating Events	5-1	103
5.2.2	Estimation of Frequency of Initiating Events	5-2	104
5.2.3	Event Tree Modeling Technique	5-2	104
5.2.4	Aggregation of Initiating Events	5-3	105
5.2.5	Hardwired System Dependency Analysis	5-3	105
5.2.6	System Interaction Analysis	5-4	106
5.2.7	Treatment of the Post-Accident Heat Removal Phase	5-5	107
5.2.8	Evaluation of Human Errors During Normal Operation	5-6	108
5.2.9	Evaluation of Human Errors During an Accident	5-6	109
5.2.10	Common Mode Analysis	5-7	109
5.2.11	Treatment of Recovery	5-8	110
5.2.12	Modeling of AC Power Systems	5-8	110
5.2.13	Modeling of Logic (Actuation) Systems	5-9	111
5.2.14	Common Cause	5-10	112
5.2.15	Component Reliability Data Base	5-10	112
5.2.16	Use of Demand Failure Probabilities	5-11	113
5.2.17	Use of Means Versus Use of Medians	5-12	114
5.2.18	System Success Criteria	5-12	114
5.2.19	Treatment of Test and Maintenance Outages	5-13	115
5.2.20	Environmental Qualification	5-14	116
5.2.21	External Event Methodology	5-14	116
5.2.22	Source Terms	5-17	119
5.3	Comparison and Ranking of PRA Methodologies for the Four Plants	5-18	120
6.	SUMMARY	6-1	124
Appendix A:	DETERMINATION OF LATENT FATALITY RISK (AT >1000 FATALITIES) CONTRIBUTION FOR SEABROOK	A-1	126

LIST OF FIGURES

Figure		Page	
1.1	Comparison of Millstone 3 early fatality risks, external vs internal events	1-3	5
1.2	Comparison of Millstone 3 latent fatality risks, external vs internal events	1-4	6
2.1	SSPSA risk of early fatalities	2-3	32
2.2	Risk of latent cancer fatalities (other than fatal thyroid cancers)	2-3	32
4.1	Oconee Unit 3 risk curves for all internal initiating events: (a) latent-cancer fatalities and (b) early fatalities	4-21	99
4.2	Oconee Unit 3 risk curves for external initiating events (modified plant): (a) latent-cancer fatalities and (b) early fatalities	4-22	100

LIST OF TABLES

Table		Page	
1.1	Millstone 3 Transient Initiator List	1-2	4
1.2	Millstone 3 Dominant Accident Sequences Contributing to Core Melt, Early Fatalities, and Latent Fatalities for Internal Events	1-6	8
1.3	Initiating Event Categories - Contribution to Core Melt Probability (Internal Events Only)	1-8	10
1.4	System and Component Failure Contributions to Millstone 3 Sequences Dominating Core Melt Probability (Internal Events Only)	1-9	11
1.5	System and Component Failure Contributions to Millstone 3 Sequences Dominating Latent Fatality Risk (Internal Events Only)	1-14	16
1.6	System and Component Failure and Failure Mode Contributions to Core Melt Probability (Internal Events Only)	1-15	17
1.7	System and Component Failure Contributions to Latent Fatality Risk (Internal Events Only)	1-18	20
1.8	Summary of System and Component Failures and Failure Mode Contributions to CMP (Internal Event Only)	1-20	22
1.9	Summary of System and Component Failures and Failure Mode Contributions to Latent Fatlaity Risk (Internal Events Only)	1-23	25
1.10	External Event Initiators Considered in the PSS	1-24	26
1.11	Summary of External Event Risks from Seismic Events for Millstone 3	1-24	26
1.12	Summary of External Event Risks from Fires	1-26	28
2.1	Seabrook Transient Initiator List	2-2	31
2.2	Seabrook Dominant Accident Sequences Contributing to Core Melt, Early Fatalities, and Latent Fatalities for Internal Events	2-4	33
2.3	Dominant Accident Sequences Grouped by Initiating Event (Internal Events Only)	2-7	36
2.4	System and Component Failure Contributions to Seabrook Sequences Dominating Core Melt Probability (Internal Events Only)	2-8	37
2.5	System and Component Failure Contributions to Seabrook Sequences Dominating Latent Fatality Risk (Internal Events Only)	2-13	43
2.6	System and Component Failure and Failure Mode Contributions to Core Melt Probability for Seabrook (Internal Events Only)	2-14	43
2.7	System and Component Failure Contributions to Latent Risk for Seabrook (Internal Events Only)	2-17	46
2.8	Summary of System and Component Failures and Failure Mode Contributions to CMP for Seabrook (Internal Events Only)	2-18	47
2.9	Summary of System and Component Failures and Failure Mode Contributions to Latent Fatality Risk for Seabrook (Internal Events Only)	2-20	49
2.10	External Event Initiators Considered in the SSPSA for Seabrook	2-22	51
2.11	Summary of External Event Risks from Seismic Events for Seabrook	2-23	52
2.12	Summary of External Event Risks from Fires for Seabrook	2-23	52
3.1	Summary of the Categories of BWR Transients Used in SNPS-PRA	3-2	55
3.2	Other Postulated Low Frequency Transients	3-4	57
3.3	Leading Sequences for Contribution to CMP from Shoreham PRA and BNL Review (Internal Events)	3-6	59
3.4	Accident Sequences for Shoreham Grouped by Initiating Event & Timing (Internal Only)	3-12	65

Table		Page
3.5	Initiating Event Categories Contribution to Core Melt (Internal)..	3-13 66
3.6	System and Component Failure Contributions to Shoreham Leading CM Sequences.....	3-14 67
3.7	Total System and Component Failure Contributions from Leading Cut Sets.....	3-19 72
3.8	Failure Mode Contribution to CMP from Leading Cut Sets.....	3-21 74
3.9	System Contribution to CMP from Leading Cut Sets.....	3-21 74
3.10	Component Contribution to CMP from Leading Cut Sets.....	3-21 74
3.11	Summary of Release Parameters for Ex-Plant Consequences.....	3-23 76
3.12	Summary of Shoreham Release Categories with Potentially Severe Radiological Impact.....	3-24 77
3.13	Description of the Severe Release Categories Identified by the Shoreham PRA.....	3-25 78
4.1	Internal Initiating Events for the Oconee PRA.....	4-2 80
4.2	Leading Sequences for Contribution to CMP - Oconee 3 (Internal Events).....	4-5 83
4.3	Mean Annual Core Melt Frequencies for Internal Initiating Events..	4-7 85
4.4	Internal Initiating Event Categories--Contribution to Core Melt Probability.....	4-7 85
4.5	System and Component Failure Contributions to Oconee 3 Sequences Dominating Core Melt Probability (Internal Events).....	4-8 86
4.6	Total System and Component Failure Contribution to CMP from Leading Sequences.....	4-11 89
4.7	Failure Mode Contribution to CMP from Leading Sequence/Cut Sets (Oconee).....	4-13 91
4.8	System Contribution to CMP from Leading Sequence/Cut Sets (Oconee).....	4-13 91
4.9	Component Failure Contribution to CMP from Leading Sequence/Cut Sets.....	4-13 91
4.10	Mean Annual Core Melt Frequencies for External Initiating Events..	4-14 92
4.11	External Events - Oconee.....	4-15 93
4.12	Summary of Oconee Release Categories.....	4-23 101
4.13	Summary of Consequence Ranges for Which Release Categories Affect Risk Curves.....	4-24 102
5.1	Comparison and Ranking of PRA Methodologies for Four Plants.....	5-19 121
A.1	Contribution of Release Categories to Risk of Latent Cancer Fatalities for Seabrook.....	A-3 128
A.2	Contribution of Release Categories to Plant Damage States.....	A-3 128
A.3	Contribution of External Events to Seabrook Plant Damage States...	A-4

ACKNOWLEDGMENTS

This work was performed for the Reliability and Risk Assessment Branch (RRAB) of the U.S. Nuclear Regulatory Commission. Ms. Sarah Davis of RRAB was the technical monitor of the Project. The authors would like to acknowledge the guidance and constructive commentary provided by Ms. Davis throughout this effort. The authors would also like to express their appreciation to Cheryl Conrad, Nancy Nelson, and Sheree Flippen for their untiring efforts in coordinating and typing this document.

BLANK PAGE

EXECUTIVE SUMMARY

This review of four probabilistic risk assessments (PRAs) was conducted by Brookhaven National Laboratory (BNL) under the sponsorship of the U.S. Nuclear Regulatory Commission, with the goal of gaining insights into nuclear plant safety, nuclear plant vulnerabilities, and PRA methodologies. The four PRAs under investigation are those for Millstone 3, Seabrook, Shoreham, and Oconee 3. This effort was not intended as a vehicle for verifying the specific details and results of these PRAs, but rather -- having accepted the results of the PRAs -- for ascertaining what the results might mean on a plant-specific and/or generic basis. For two of the four PRAs, those for Millstone 3 and Shoreham, NRC-sponsored reviews had been completed and documented, and these were utilized in the effort; for the other two, the reviews had not been completed.

This review focused on identifying the dominant (leading) initiators, failure modes, plant systems, and specific components that affect the overall core melt probability and/or risk to the public. Each PRA was analyzed with respect to these items, and plant-specific insights were drawn from the results. In addition, the various elements of the methodologies employed by the four PRAs were discussed and ranked (per NUREG/CR-3852, "Insights into PRA Methodologies").

Perhaps the most important insight with respect to nuclear safety was the following, derived from the Oconee PRA:

- The core melt probability and public risk associated with the interfacing systems LOCA (event V), as demonstrated in the Oconee PRA, can be substantially reduced by appropriate selection of operating configuration and testing procedures and prohibition of testing of the interfacing valves with the reactor at power/pressure.

The following are other overall insights gained from this study. (Plant-specific insights are discussed in connection with each PRA).

- All four PRAs were carried out with numerous refinements over the WASH-1400 effort and have yielded more realistic results.

- The core melt probability due to internal events is roughly equal (within error bounds) for three of the plants and relatively close for the fourth (Seabrook).

- With the possible exception of the low pressure service water system initiator at Oconee, none of the PRAs shows any internal events to be "outliers."

- The dominant risk sequences represent only a small fraction (typically less than 1%) of the total contribution to core melt probability (CMP) and are characterized by loss of the containment function due to direct bypass or overpressurization.

- In the two PRAs (Millstone and Seabrook) which specifically documented risk contribution by sequence, interfacing systems LOCA represents

over 98% of the total contribution to early fatalities. Although not specifically quantified, the Shoreham PRA appears to identify large LOCA with early suppression pool failure as its leading contributor to early fatalities.

- The leading contributors to latent fatalities would appear to be interfacing systems LOCA, large LOCA with early containment failure, station blackout greater than six hours and RCP seal LOCA.

- The Snoreham PRA insights listed in Section 3 are driven to a large extent by one major assumption within the PRA. The PRA has adopted a generic failure to scram probability from NUREG-0460 and assumes the common mode failure of the control rods to insert to be the only contributor. The PRA states that a Shoreham-specific analysis was done and that the results were on the order of 25% lower than the NUREG but were not used in the study. Had these results been used, the CMP as well as the dominant sequences, failure modes, system failures, and component failures would all be affected.

- The various plant PRAs show wide variance as to what internal accident initiators dominated the CMP. For Shoreham boiling water reactor (BWR), anticipated transient without scram (ATWS) dominated and loss of coolant accidents (LOCAs) were insignificant. For Oconee, LOCAs contributed approximately 30% of the CMP and a large LOCA contributed 1.5 times as much as a small LOCA. Even the two Westinghouse plants (Seabrook and Millstone) were considerably different from one another. The Seabrook and the Millstone PRAs both found the CMF contribution of a small LOCA greater than large LOCA, but a small LOCA contributed 11% in Seabrook and 24% in Millstone.

- The CMP and the percentage contribution from internal and external initiators are shown below for the four PRAs analyzed.

Plant	Total Core Melt Probability (CMP)	Contribution from Internal Initiators (%)	Contribution from External Initiators (%)
Millstone	5.89E-05	76.4	23.6
Seabrook	2.30E-04	80.0	20.0
Oconee	2.54E-04	21.3	78.7
Shoreham	5.50E-05	100.0	*

*External events were not part of the PRA as reviewed.

The main insight drawn from these results is that the usual percentage breakdown of the contribution of internal versus external initiators of abcut 80/20 was fully reversed in the Oconee study. The Oconee results are for the modified plant; the external initiator dominance (mainly internal floods) was even more dominant in the original plant.

INTRODUCTION

This report summarizes the findings of an investigation of four probabilistic risk assessments (PRAs), those for Millstone 3, Seabrook, Shoreham, and Oconee 3, performed by Brookhaven National Laboratory (BNL) for the Reliability and Risk Assessment Branch of the U.S. Nuclear Regulatory Commission. The objectives of this work were 1) to identify and rank initiators, systems, components, and failure modes from dominant accident sequences according to their contribution to core melt probability and public risk; 2) to break down the various elements of the methodologies employed and evaluate and rank them in accordance with the guidelines of NUREG/CR-3852, "Insights into PRA Methodologies"; and 3) to derive from this process plant-specific, methodological, and generic insights. This effort was not intended to verify the specific details and results of each PRA but rather -- having accepted the results -- to see what they might mean on a plant-specific and/or generic basis. The NRC has sponsored full detailed reviews of each of these PRAs, but only two, those for Millstone 3 and Shoreham, were completed and fully documented in time to allow their incorporation into this effort.

Millstone 3 was in its latter phases of construction when the PRA was completed. It is a Westinghouse pressurized water reactor (PWR) and shares a coastal Connecticut site with two other operating nuclear power plants, Millstone 1, a General Electric boiling water reactor (BWR), and Millstone 2, a Combustion Engineering PWR. Section 1 of this report presents an analysis of the dominant accident sequences with respect to core melt probability (CMP) and public risk, provides a breakdown of initiators, failure modes, systems, and components related to the dominant sequences, and lists the insights derived from this effort.

Seabrook was also in a construction phase when its PRA was completed. It is a Westinghouse PWR, located on a coastal New Hampshire site. Section 2 provides a review analogous to that for Millstone but with the major difference that, although internal and external initiating events were not separated in the Seabrook PRA, they were separated in this report to be consistent with the other report sections. Because of the format of the results in this PRA, the contribution to latent fatalities from external events could not be ascertained in a straightforward way; the method used to determine it is described in Appendix A.

Shoreham was also in a construction phase when the PRA was completed. It is a General Electric BWR, located on Long Island, New York, on the coast of Long Island Sound. Section 3 provides a review analogous to that for Millstone with the following differences: 1) the Shoreham PRA considered only one external initiating event, flooding at level 8 in the reactor building, and combined this with the internal events, and 2) it stopped short of a public risk assessment by providing only the expected radiological releases by release category.

Oconee 3, a Babcock & Wilcox PWR, is the only fully operational plant of the four in this study. It shares an inland site in South Carolina with two other nuclear power plants, Oconee 1 and Oconee 2, that are essentially identical to it. Unique features here include a dam and reservoir at the site and an earthen dam upstream of the site. Since the lower levels of the turbine building are below the level of the reservoir, turbine building flooding is

the dominant core melt initiator for this plant. Section 4 provides a review of the Oconee 3 PRA analogous to the others.

In Sections 1 through 4 of this report, insights have been derived on a plant by plant (PRA by PRA) basis. Insights derived by any of the PRAs or their reviews (where available) were, to the extent practicable, not repeated here.

In Section 5 the four PRAs are compared in terms of the various methodologies applied by each to accomplish the same goals. Table 5.1 explicitly ranks each PRA per NUREG/CR-3852, "Insights into PRA Methodologies," and includes some additional categories. The latter were added in the evaluation of the methodologies by the project team to provide greater breadth to the comparison and include some aspects of external events, a subject not addressed in the NUREG report.

Section 6 provides a brief summary of the effort and lists the insights derived from the four PRAs taken as a whole, and those from the individual PRAs that were thought to be worth highlighting.

1. INSIGHTS FROM THE MILLSTONE 3 PROBABILISTIC SAFETY STUDY

1.1 Introduction

This section presents an overview of the results from the Millstone 3 Probabilistic Safety Study (PSS)[1] and selected insights derived from these results. It also includes comparative results and insights from a review of the PSS performed by Lawrence Livermore National Laboratory (LLNL) for the NRC.[2] It is not the purpose of this effort to review the PSS or to judge the validity of the LLNL review. Rather, the results from both the PSS and the LLNL review are used as is, and the insights are based entirely on these results.

Following a brief overview of the PSS and LLNL results, the leading accident sequences contributing to both core melt probability and risk (of early and late fatalities) are examined in detail to obtain the following insights:

- Relative significance of initiating events.
- System and component failure contributions to leading accident sequences.
- Failure mode (i.e., human error, random, dependent, etc.) contributions to leading accident sequences.

In conjunction with these insights, additional perspective is provided, as appropriate, regarding the relative significance of leading sequences and the different characteristics of the accident sequence "mix" for core melt probability and risk.

The results for internal and external accident initiating events are considered separately. This is in accordance with discussions in the PRA reference document[3] and is also consistent with a similar separation in the PSS itself.

1.2 Internal Events

This section presents results and insights from internal initiating events. Internal initiators are defined in the PSS as loss-of-coolant accidents and transients, where transients are confined to those disruptions listed in Table 1.1 (reproduced from Table 11-2 of the PSS).

1.2.1 Overall Results

According to Volume 1, Section V, of the PSS, the total core melt probability from internally initiated accidents is 4.5E-5/reactor-year. The PSS does not provide a value for the individual risk of early and latent fatalities, but Volume 1 includes curves of exceedence frequency vs number of fatalities (both early and latent) which are compared with WASH-1400 results. The PSS results for both are significantly less (by more than a factor of 10) than those in WASH-1400. Figure 1.1 shows a comparison of early fatality risk, with the 50% and 90% confidence levels. Figure 1.2 is a similar plot for latent fatality risk.

Table 1.1 Millstone 3 Transient Initiator List

1. Control Rod Drive Mechanism Break or Failure
2. Control Rod Ejection
3. Control Rod Withdrawal
4. Control Rod Drop
5. Control Rod Drive Mechanism Malfunction
6. Reactor Coolant Pump Trip
7. Reactor Coolant Pump Locked Rotor
8. Multiple Reactor Coolant Pump Trips
9. Reactor Coolant Pump Shaft Failure
10. Startup of Inactive Coolant Pump
11. CVCS Malfunction - Boron Dilution
12. Inadvertent Safety Injection Signal
13. High or Low Pressurizer Pressure
14. High or Low Pressurizer Level
15. Reactor Trip - Spurious Trip, Unknown Cause
16. Reactor Trip - Manual Trip, Operator Error
17. Reactor Trip - Pressure, Temperature or Power Imbalance
18. Reactor Trip - Auto Trip, Hardware Error
19. Loss of Component Coolant
20. Loss of Instrument Air
21. Loss of Service Water
22. Loss of Circulating Water
23. Loss of Condenser Vacuum
24. Loss of Offsite Power
25. Loss of Essential Service Buses
26. Loss of One or More Condensate Pumps
27. Reduction in Feedwater Flow
28. Reduction in Feedwater Temperature
29. Total Loss of Feedwater
30. Increase in Feedwater Flow in One or More Loops
31. Full or Partial Closure of One or More MFWIV
32. Closure of all MFWIVs
33. Feedwater Flow Instability - Operator Error
34. Feedwater Flow Instability - Miscellaneous Mechanical Causes
35. Miscellaneous Leakage in Secondary System
36. Condenser Leakage
37. Feedwater Line Break Downstream of MFWIV
38. Feedwater Line Break Upstream of MFWIV
39. Steam Line Break Downstream of MSIVs
40. Steam Line Break Upstream of MSIVs
41. Full or Partial Closure of One or More MSIV
42. Closure of all MSIVs
43. One or More Steam Generator Relief Valves Fails Open
44. One or More Steam Generator Safety Valves Fails Open
45. One or More Steam Dump Valves Fails Open
46. Automatic Turbine Trips
47. Throttle Valve Closure - EHC Control Problems
48. Generator Trip or Generator Caused Faults
49. Throttle Valve Opening - EHC Control Problems
50. Reduction of External Load
51. Loss of External Load
52. Turbine Generator Overload
53. Full or Partial Control Bus Failure

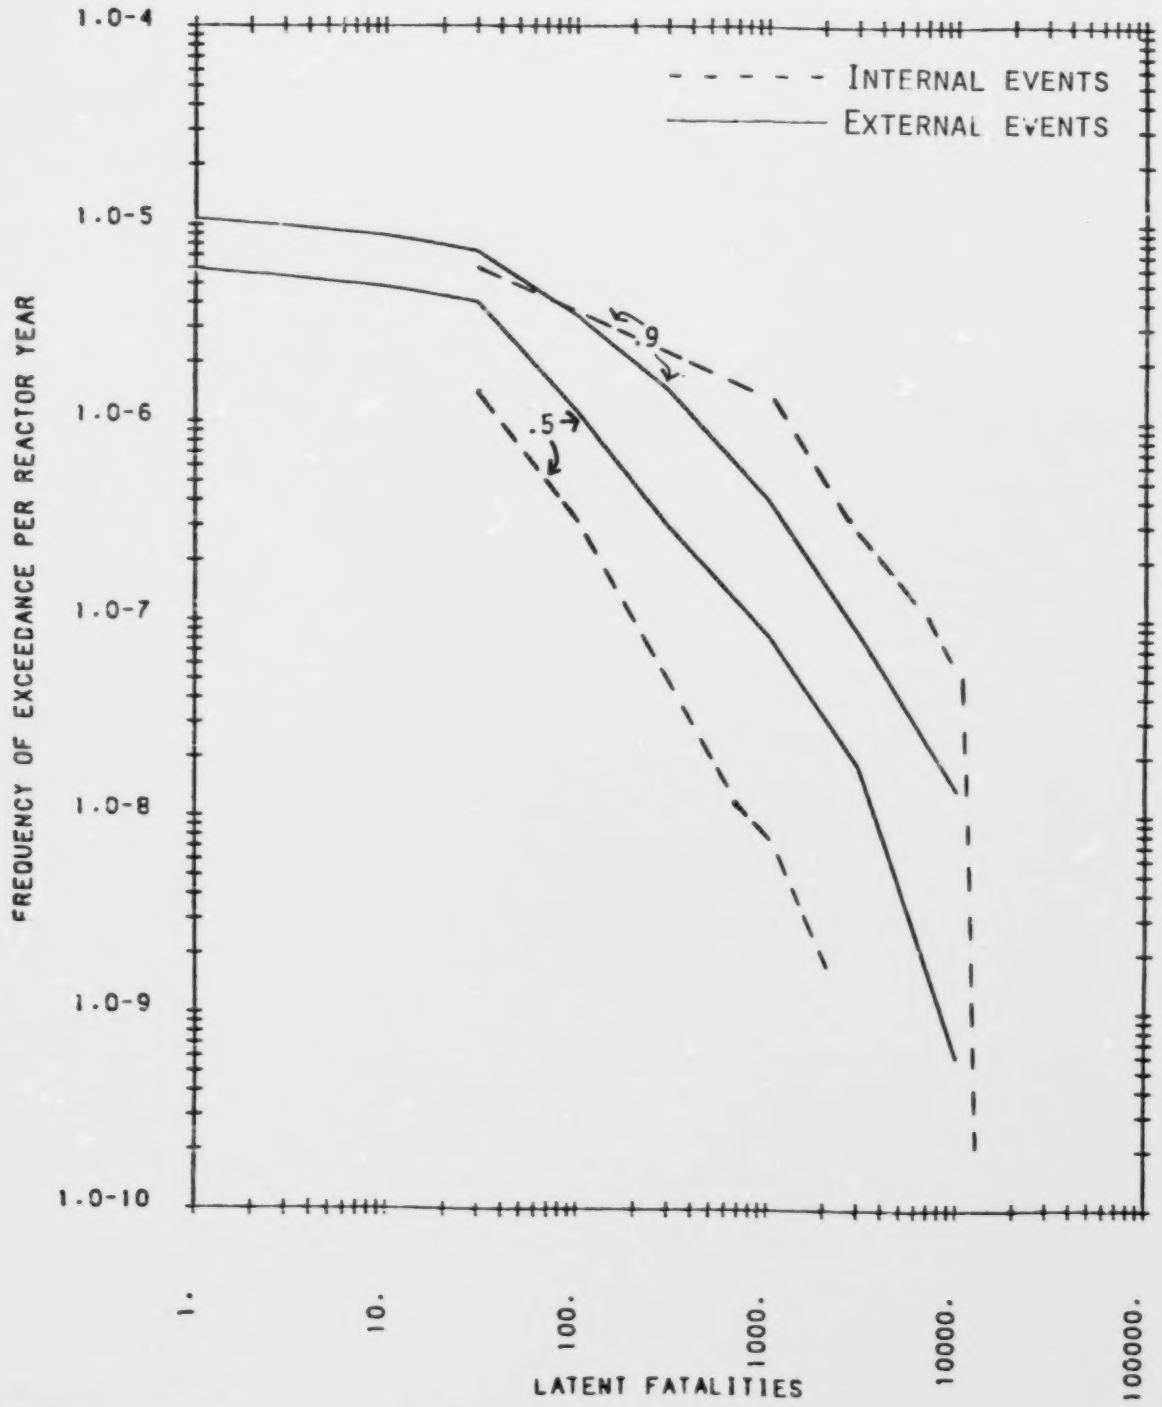

Figure 1.1 Comparison of Millstone 3 early fatality risks, external vs internal events.

BEST COPY AVAILABLE

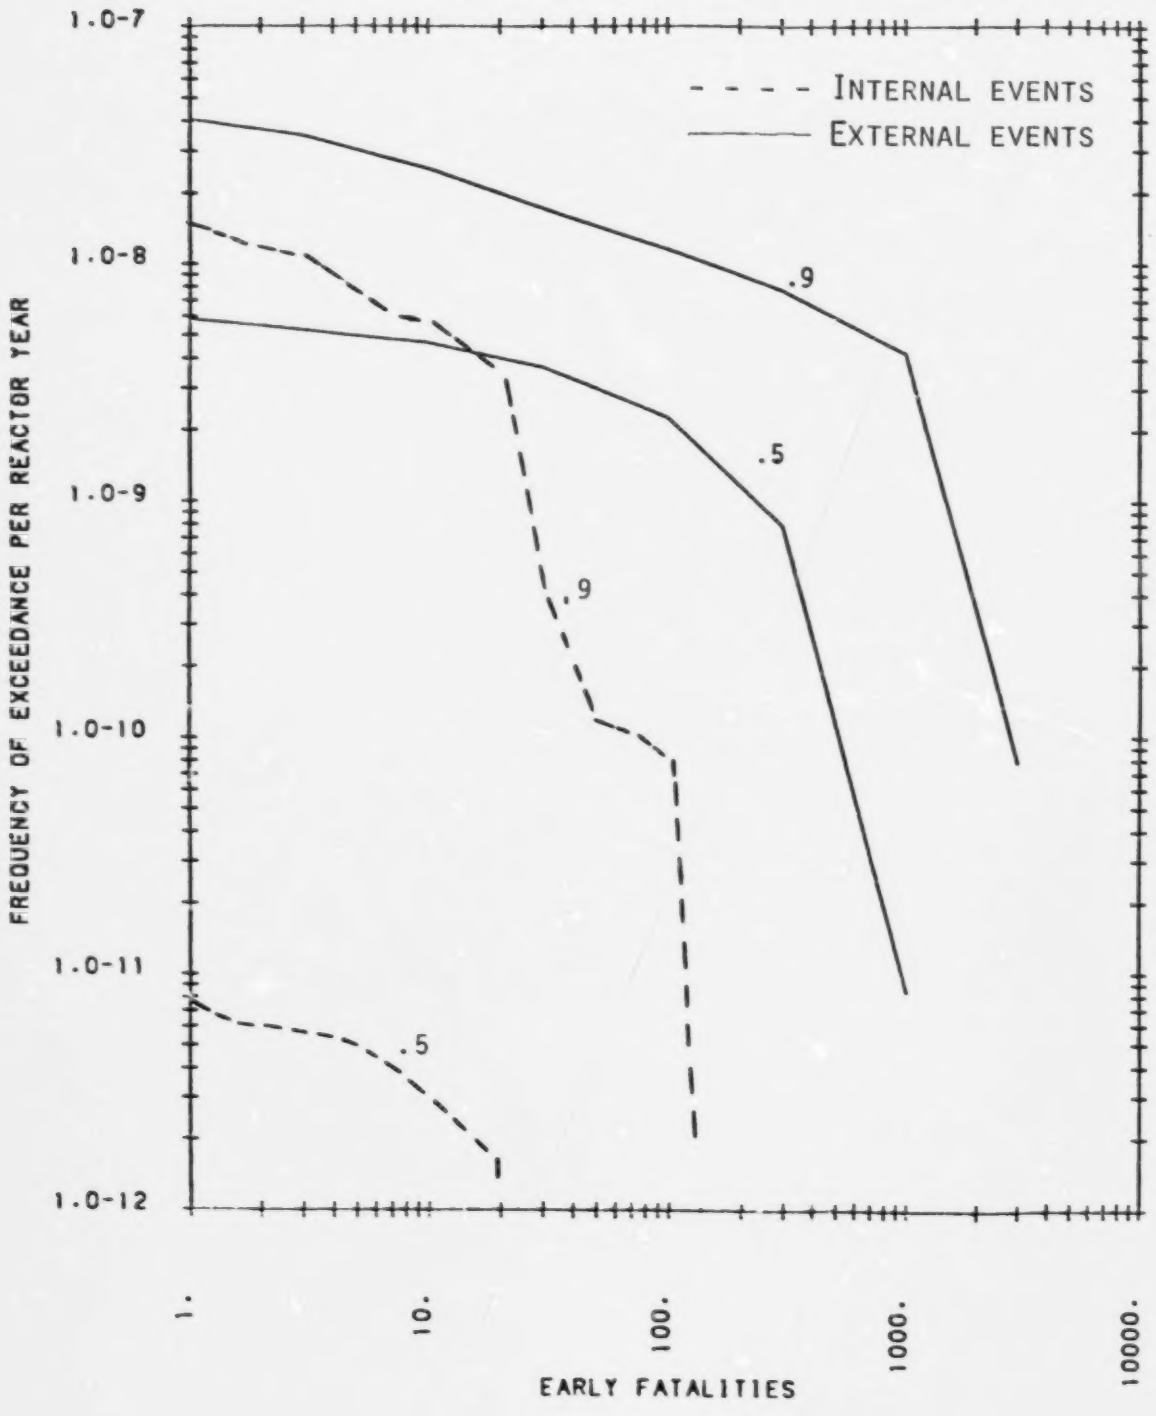

Figure 1.2 Comparison of Millstone 3 latent fatality risks, external vs internal events.

BEST COPY AVAILABLE

1.2.2 Dominant Sequences

Table 1.2, reproduced from Table V-1 of the PSS, lists accident sequences that are leading contributors to core melt probability, early fatalities (>100), and latent fatalities (>1000). It provides some interesting insights relative to the significance of individual accident sequences and the mix of sequences contributing to core melt probability vs risk:

- No single sequence makes a very large contribution to core melt probability. The leading sequence contributes only 8.5% to the total, and the ten leading sequences together contribute less than 50% (43.1%).
- One single sequence (interfacing systems LOCA) overwhelms all others with regard to early fatalities, contributing 99.8% to the total.
- Two sequences (ranked five and six in the first column) dominate the contribution to latent fatalities (46.3%), and six others are significant contributors (greater than 2%).
- The top six leading contributors to core melt probability include significant contributors also to early fatalities (99.8% contribution from Sequence 5) and latent fatalities (46.3% contribution from Sequences 5 and 6).

1.2.3 Initiating Events

Table 1.3, constructed from information in the LLNL review,[2] provides a breakdown of core melt contributors in which accident sequences have been "binned" on the basis of common accident initiating events. It gives the aggregate probability of all sequences in each category as estimated by the PSS and by the LLNL review. The last two columns show that the categories used contribute 96% to the total core melt probability in the PSS and 89% in the LLNL review.

- Transients and small LOCAs dominate core melt probability. In the PSS, transients contributed more than half of the total CMP, and small LOCAs about a quarter. In the LLNL review, transients and small LOCAs were also found to be dominant, but the small LOCA initiators were more significant.
- For early fatalities, the total probability comes almost entirely (99.8%) from the contribution of a single sequence which is initiated by an interfacing systems LOCA.

1.2.4 System and Component Failures and Failure Modes

The contribution to core melt probability and risk from individual system and component failures, as well as failure modes (human error, dependencies, etc.), were examined.

Table 1.4 lists the contribution from system and component failures to each of the ten core melt probability sequences (1 through 10 of Table 1.1).

Table 1.2 Millstone 3 Dominant Accident Sequences Contributing to Core Melt, Early Fatalities, and Latent Fatalities for Internal Events

Rank with Respect to Core Melt	Sequence Description	Mean Annual Frequency	Percent Contribution to Core Melt Frequency	Percent Contribution to Early Fatalities (at >100 Fatalities level)	Percent Contribution to Latent Fatalities (at >1000 Fatalities level)
1	Medium LOCA: Failure of High-Pressure Recirculation	3.87E-6	8.5	<0.1	<0.1
2	Loss of Vital DC Bus 1 or 2: Failure of Auxiliary Feedwater, Failure of Bleed and Feed Cooling	2.20E-6	4.9	<0.1	<0.1
3	Loss of Vital AC Bus 1 or 2: Failure of Auxiliary Feedwater, Failure of High-Pressure Recirculation	1.98E-6	4.4	<0.1	<0.1
4	Loss of Vital AC Bus 3 or 4: Failure of Auxiliary Feedwater, Failure of High-Pressure Recirculation	1.98E-6	4.4	<0.1	<0.1
5	Interfacing Systems LOCA: Failure of RHR Suction Valves	1.90E-6	4.2	99.8	27.9
6	Loss of Offsite Power: Failure of Both Diesel Generators, Failure to Recover Power in six hours, Failure of Quench Spray Recovery	1.65E-6	3.6	<0.1	18.4
7	Loss of Offsite Power: Failure of One ESF Bus, Steam Line Break Inside Containment, Failure of Auxiliary Feedwater, Failure of Primary Bleed Through PORVs	1.63E-6	3.6	<0.1	<0.1
8	Steam Line Break Outside Containment: Failure to Isolate Main Steam Line, Failure of Primary Bleed Through PORVs	1.55E-6	3.4	<0.1	<0.1
9	Small LOCA: Failure to Control Primary Depressurization, Failure of High-Pressure Recirculation	1.39E-6	3.1	<0.1	<0.1
10	Large LOCA: Failure of Low-Pressure Recirculation	1.37E-6	3.0	<0.1	<0.1
19	Loss of Vital AC Bus 1 or 2: Failure of Opposite Train ESF Cabinet, Failure of Auxiliary Feedwater, Failure of Bleed and Feed Cooling, Failure of Quench Spray	7.23E-7	1.6	<0.1	8.0

Table 1.2 Continued

Rank with Respect to Core Melt	Sequence Description	Mean Annual Frequency	Percent Contribution to Core Melt Frequency	Percent Contribution to Early Fatalities (at >100 Fatalities level)	Percent Contribution to Latent Fatalities (at >1000 Fatalities level)
20	Primary to Secondary Power Mismatch: Failure of Both ESF Cabinets, Failure of Auxiliary Feedwater, Failure of Bleed and Feed Cooling, Failure of Quench Spray	6.15E-7	1.4	<0.1	6.9
25	Reactor Trip: Failure of Both ESF Cabinets, Failure of Auxiliary Feedwater, Failure of Bleed and Feed Cooling, Failure of Quench Spray	4.87E-7	1.1	<0.1	5.4
31	Turbine Trip: Failure of Both ESF Cabinets, Failure of Auxiliary Feedwater, Failure of Bleed and Feed Cooling, Failure of Quench Spray	3.74E-7	0.8	<0.1	4.1
40	Primary to Secondary Power Mismatch: Coincident Station Blackout, Small LOCA, Failure of High-Pressure Injection, Failure of Secondary Depressurization and Low-Pressure Injection, Failure of Quench Spray Recovery	2.43E-7	0.5	<0.1	2.7
46	Reactor Trip: Coincident Station Blackout, Small LOCA, Failure of High-Pressure Injection, Failure of Secondary Depressurization and Low-Pressure Injection, Failure of Quench Spray Recovery	1.92E-7	0.4	<0.1	2.1
54	Turbine Trip: Coincident Station Blackout, Small LOCA, Failure of High-Pressure Injection, Failure of Secondary Depressurization and Low-Pressure Injection, Failure of Quench Spray Recovery	1.48E-7	0.3	<0.1	0.7
70	Loss of Vital AC Bus 1 or 2: Failure of Auxiliary Feedwater, Failure of High-Pressure Recirculation, Failure of Containment Recirculation Spray	9.36E-8	0.2	<0.1	1.2

Table 1.3 Initiating Event Categories - Contribution to Core Melt Probability (Internal Events Only)

Initiator	Probability		% Contribution to CMP	
	PSS	LLNL Rev.	PSS	LLNL Review
Transients	2.3E-5	3.2E-5	51	32
Small LOCA	1.1E-5	5.1E-5	24	51
Large LOCA	7.8E-6	4.8E-6	17	5
Interfacing LOCA	1.9E-6	8E-7	4	1
Total	4.5E-5	1E-4	96	89

10

Table 1.4 System and Component Failure Contributions to Millstone 3 Sequences Dominating Core Melt Probability (Internal Events Only)

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
1	8.5	High-Pressure Recirculation	5.8E-3	Human Error	15	—	—	
				Common Cause	26	MOVs	12	Common cause failures are in the containment spray recirculation system
						Pumps	2.5	
2	4.9	Aux Feed	5.9E-4	Random Component	53	MD and Turbine Pumps	37	
						MD Pump Actuation and Turbine Pump	16	
				Common Cause	10	(Unspecified)	10	
				Test Plus Random	5	Turbine Pump and test of MD pump	5	
		Feed and Bleed	1.0	Dependent (Loss of dc power bus fails PORV)	100	PORV	100	Failure of one or two PORVs assumed to fail feed and bleed
3	4.4	Aux Feed	5.9E-4	Random Component	53	MD and Turbine Pumps	37	
						MD Pump Actuation and Turbine Pump	16	
				Common Cause	10	(Unspecified)	10	

Table 1.4 Continued

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
3(Cont.)	4.4	Aux Feed (Cont.)	5.9E-4	Random plus test	5	Turbine Pump and Test of MD Pump	5	
		High-Pressure Recirculation	5.84E-2	Random	51	Valves (fail to change state)	32	
						Valves (plug or fail to remain open)	19	
4	4.4	Aux Feed	5.9E-4	Random Component	53	MD and Turbine Pumps	37	
						MD Pump Actuation and Turbine Pump	16	
				Common Cause	10	(Unspecified)	10	
				Random Plus Test	5	Turbine Pump and test of MD pump	5	
		High-Pressure Recirculation	5.84E-2	Random	51	Valves (fail to change state)	32	
						Valves (plug or fail to remain open)	19	
5	4.2	RHR	1.9E-6	Random	100	Valves (catastrophic internal leak)	100	System failure is also accident initiator

Table 1.4 Continued

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
6	3.6	Emergency AC Power	4.56E-4	Common Cause	53	Diesels	53	
		Quench Spray	8.19E-3	Dependent	88	Pumps	88	Dependency is on nonrecovery of AC in six hours
				Human Error	12	—	—	
7	3.6	ESF has Failure	1.4E-2	Random	99	Diesel Gen. ESF Cabinet EGLS Cabinet	87 7 6	
		Aux Feed	4.53E-2	Random	90	Steam Turbine Pump	90	
				Test & Maint	5	Turbine Pump	5	
		Feed & Bleed	1.0	Dependent	100	PORV	100	Both PORVs assumed to be required
8	3.4	MSL Isolation	1.5E-3	Common Cause	91	Valves	91	
		Feed & Bleed	2.76E-2	Random	64	PORV Block Valve	40 24	
				Human Error	36	—	—	

Table 1.4 Continued

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
9	3.1	FS Depressurization	1E-2	Human Error	100	—	—	
		High-Pressure Recirculation	1.59E-2	Common Cause	26	Valves	12	
						Pumps	2.5	
				Human Error	15	—	—	
10	3.0	Low-Pressure Recirculation	4.02E-3	Human Error	25	—	—	
				Common Cause	13.4	Valves	9.8	
						Pumps	3.6	
				Random	4.5	Valves Plugging	4.5	

The information was obtained from various sections of the PSS and from additional analyses needed to extract individual contributions. It should be emphasized that the breakdown of each system within this table was not derived directly from sequence cut sets. Rather, the breakdown came from the analysis of each individual system. This was necessitated because sequence cut sets were not provided. The reader is therefore cautioned that any sequence-dependent failures listed in the table are based upon this review and due to the limited scope of this review the listings may not be exhaustive.

The first column of Table 1.4 identifies the sequence by number corresponding to the Table 1.1 sequences. The second column provides the core melt probability contribution (in percent) from the individual sequences. The third column lists all of the system failures associated with each sequence, and the fourth column gives the probability of each system failure. It is important to note that these probabilities, as provided in the PSS, are conditional that is, dependent upon the initiating event and any preceding system failures. The fifth column provides the failure mode contributions to each of the system failures. Five such modes were identified in the PSS: common cause, dependent, random, human error, and test. As used herein, dependent failures refer exclusively to failures related to the initiating event and preceding system failures.

The sixth column identifies the fractional contribution of each failure mode to the total system failure probability. For example, in Sequence 1, 15% of the failure probability of the high-pressure recirculation system is from human error and 26% from common cause failures. Note that in many cases (including this example) the column six failure mode contributions do not total to 100%. This is because only those modes identified in the PSS as dominant contributors are considered. Resources did not permit detailed examination of individual cut sets and fault trees to extract further detail on failure modes for lesser contributors. In nearly all cases, however, the failure modes identified in the sixth column account for over half of the total system failure probability, and for many (about 1pIJof the systems the identified failure modes contribute over 90% of the total.

The seventh column identifies the components associated with the relevant failure modes. For the dependent and human error modes, no components are identified since for these modes individual component failures are not associated with the system failure. The eighth column provides the individual component contribution to system failure for each failure mode. For example, for Sequence 1, 12% of the system failure probability is due to common mode failures of motor operated valves. The last column provides some clarifying information pertinent to the appropriate system.

Table 1.5 gives information similar to that in Table 1.4, for latent fatality risks. As discussed previously, six leading sequences contribute to latent fatality risks. Two of these (Numbers 5 and 6) are also contributors to the core melt probability and therefore the information about them, identical to that in Table 1.4, is not repeated. In Table 1.5, the "test" mode of failure has no associated component since the entire system is assumed to be in the test mode and therefore unavailable.

From information provided in Table 1.4, Table 1.6 was constructed in order to consolidate the contributions to CMP and risk from systems, failure

Table 1.5 System and Component Failure Contributions to Millstone 3 Sequences Dominating Latent Fatality Risk (Internal Events Only)

Sequence	% Contribution Latent Fatalities	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
5	27.9	——	——	——	——	——	——	See Table 5
6	18.4	——	——	——	——	——	——	See Table 5
19	8.0	AC Bus	6.15E-2	Unspecified	—	—	—	Obtained from initiating event data base
		ESF Cabinet	1.18E-5	Test	29	—	—	
				Random	58	Logic Cards	41	
						Output Relay	17	
		Aux Feed	1.0	Dependent	100	—	—	
		Feed & Bleed	1.0	Dependent	100	—	—	
		Quench Spray	1.0	Dependent	100	—	—	
20	6.9	ESF Cabinets	1.61E-7	Test	29	—	—	
				Random	58	Logic Cards	41	
						Output Relay	17	
		Aux Feed	1.0	Dependent	100	—	—	
		Feed & Bleed	1.0	Dependent	100	—	—	
		Quench Spray	1.0	Dependent	100	—	—	
25	5.4	——	——	——	——	——	——	Same as Sequence 20 above
31	4.1	——	——	——	——	——	——	Same as Sequence 20 above

Table 1.6 System and Component Failure and Failure Mode Contribution To Core Melt Probability (Internal Events Only)

System	Seq. No.	% CMP	System Failure Mode Contribution, % (Contribution to CMP, %)					
			Common Cause	Random	Dependent	Human Error	Test	Unspecified
High-Pressure Recirculation	1	8.5	12 (1.02)-MOV	--	--	15 (.47)	--	59 (5.0)
			2.5 (.21)-P	--			--	
			11.5 (.98)-U	--			--	
	3	4.4	--	51 (2.2)-P	--	--	--	49 (2.2)
	4	4.4	--	51 (2.2)-P	--	--	--	49 (2.2)
	9	3.1	12 (.37)-MOV	--	--	15 (.47)	-	59 (1.8)
			2.5 (.08)-P					
			11.5 (.36)-U					
	Totals	20.4	3.02	4.4	--	1.77	--	11.2
Auxiliary Feedwater	2	4.9	10 (.49)-U	53 (2.6)-P	--	--	5 (.25)	32 (1.6)
	3	4.4	10 (.44)-U	53 (2.3)-P	--	--	5 (.22)	32 (1.4)
	4	4.4	10 (.44)-U	53 (2.3)-P	--	--	5 (.22)	32 (1.4)
	7	3.6	--	90 (3.2)-P	--	--	5 (.18)	5 (.18)
	Totals	17.3	1.37	10.4	--	--	.87	4.58
Feed & Bleed	2	4.9	--	--	100 (4.9)	--	--	--
	7	3.6	--	--	100 (3.6)	--	--	--
	8	3.4	--	40 (1.4)PORV	--	36 (1.2)	--	--
				24 (.82)BV				
	Totals	11.9	--	2.2	8.5	1.2	--	--

Table 1.6 Continued

System	Seq. No.	% CMP	System Failure Mode Contribution, % (Contribution to CMP, %)					
			Common Cause	Random	Dependent	Human Error	Test	Unspecified
Residual Heat Removal	5	4.2	--	--	100 (4.2)	--	--	--
	Totals	4.2	--	--	4.2	--	--	--
Emergency Electric Power	6	3.6	53 (1.9)-DG	--	--	--	--	47 (1.7)
	Totals	3.6	1.9	--	--	--	--	1.7
ESFBus	7	3.6	--	87 (3.1)DG 7 (.27)ESF 6 (.21)EGLS				--
	Totals	3.6		3.6				--
MSL Isolation	8	3.4	91 (3.1)-MOV	--	--	-	-	9 (.31)
	Totals	3.4	3.1					.31
Primary Depressurization	9	3.1	--	--	--	100 (3.1)	--	--
	Totals	3.1	--	--	--	3.1	--	--
Low-Pressure Recirculation	10	3.0				25 (.75)		75 (2.25)
	Totals	3.0				.75		2.25

Legend:

MOV = Motor Operated Valve
P = Pump
U = Unspecified
DG = Diesel Generator
ESF = Emergency Safeguard Features Actuation System
EGLS = Emergency Generator Load Sequences System
BV = Block Valves

modes, and components. In Table 1.6, each system is considered separately, as indicated in the first column. The second column lists each sequence (identified in Table 1.1) in which the system appears as a contributor to the sequence probability, and the third column gives the percentage contribution to CMP from each sequence.

The remaining six columns give the failure mode contributions, including an "unspecified" column which provides a quantification of the residual failure mode contribution not specified in the PSS. For the "common cause" and "random" columns, the component failure contributions to the respective failure modes are identified. The numerical entries (first number) for these columns were obtained from Table 1.5. The number in parentheses is the product of the component failure contribution and the percent contribution of the respective sequence (third column) to the CMP. This value is an absolute measure of the significance of each failure mode and component failure to the CMP.

An example will aid in interpreting Table 1.6. The high-pressure recirculation system (HPRS) appears as a system failure element in four of the CMP leading sequences (1, 3, 4, and 9). The total contribution of these four sequences to the CMP is 20.4% (shown under totals in the "% CMP" column). In other words, if the HPRS failure probability could be reduced to 0 under the conditions of the four accident sequences, the total CMP calculated by the PSS for internal events would be reduced by 20.4%. For Sequence 1, 26% of the HPRS failure probability derives from common cause failures, of which 12% are common cause MOV failures, 2.5% pumps, and 11.5% unspecified.

By multiplying these fractions by the core melt contribution (8.5%), the individual component common cause contribution to core melt probability for Sequence 1 is obtained (these are the values in parentheses: 1.02, 0.21, and 0.98). These contributions are summed as shown in the "totals" row, thus the "% CMP" for the four sequences involving the HPRS (20.4) is made up of a 3.02% contributor from all common cause failures, of which 1.39% is from motor operated valves, 0.29% from pumps, and 1.34% from components not specified in the PSS. Similarly, 4.4% of the 20.4% is from random failures of which the entire contribution is from pump failures. Human error contributes 1.77%, and a contribution of 11.2% is from unspecified failure modes of the HPRS. Thus, if it were possible to eliminate common cause failures in the HPRS, the CMP would be reduced by 3.02%, or if common cause MOV failures in the HPRS could be eliminated, a 1.39% reduction in CMP would occur.

Table 1.7 is similar to Table 1.6 nd gives the results for latent fatality risks.

Table 1.8 consolidates and summarizes the results of Table 1.6 for system failure, component failure, and failure mode contributions. Table 1.8 lists all systems which appear in the ten leading CMP sequences and the contribution each system imposes on the total CMP for internal event initiated sequences. Reducing the failure probability to 0 for each system would produce the corresponding reduction in CMP. It should be noted that improving the reliability of combinations of systems would not necessarily produce a benefit equivalent to the summation of the corresponding CMP contributions because more than one system appears in some sequences. For example, reducing the failure probability of HPRS and auxiliary feedwater to near 0 would not reduce the CMP by

Table 1.7 System and Component Failure Contributions to Latent Fatality Risk (Internal Events Only)

System	Seq. #	% Latent Fatality	Common Cause	Dependent	Random	Human Error	Unspecified	Test
Quench Spray	6	18.4	--	88 (16.2)	--	12 (2.2)	--	--
	19	8.0	--	100 (8.0)	--	--	--	--
	20	6.9	--	100 (6.9)	--	--	--	--
	25	5.4	--	100 (5.4)	--	--	--	--
	31	4.1	--	100 (4.1)	--	--	--	--
	Totals	42.8	--	40.6		2.2	--	--
Residual Heat Removal	5	27.9	--	100 (27.9)	--	--	--	--
	Totals	27.9	--	27.9	--	--	--	--
ESFCabinet	19	8.0	--	--	41 (3.3)-LC 17 (1.4)-OR	--	13 (1.0)	29 (2.3)
	20	6.9	--	--	41 (2.8)-LL 17 (1.2)-OR	--	13 (.9)	29 (2.0)
	25	5.4	--	--	41 (2.2)-LL	--	13 (.7)	29 (1.6)
	31	4.1	--	--	41 (1.7)-LL 17 (.7)-OR	--	13 (.5)	29 (1.2)
	Totals	24.4	--	--	10-LC 4.2-OR	--	3.1	7.1
Auxiliary Feedwater	19	8.0	--	100 (8.0)	--	--	--	--
	20	6.9	--	100 (6.9)	--	--	--	--
	25	5.4	--	100 (5.4)	--	--	--	--
	30	4.1	--	100 (4.1)	--	--	--	--
	Totals	24.4		24.4				

Table 1.7 Continued

System	Seq. #	% Latent Fatality	Common Cause	Dependent	Random	Human Error	Unspecified	Test
Feed & Bleed	19	8.0	--	100 (8.0)	--	--	--	--
	20	6.9	--	100 (6.9)	--	--	--	--
	25	5.4	--	100 (5.4)	--	--	--	--
	31	4.1	--	100 (4.1)	--	--	--	--
	Totals	24.4	--	24.4	--	--	--	--
Emergency Electric Power	6	18.4	53 (9.8)-DG	--	--	--	47 (8.6)	--
	Totals	18.4	9.8-DG	--	--	--	8.6	--
AC BUS	19	8.0	--	--		--	100 (8.0)	--
	Totals	8.0					8.0	

LEGEND:

MOV = Motor Operated Valves
DG = Diesel Generators
LC = Logic Cards
OR = Output Relay

Table 1.8 Summary of System and Component Failures and Failure Mode Contributions to CMP (Internal Event Only)

System	% Contribution	Failure Mode Contribution (%)						Component Failure Contribution (%)
		Common Cause	Random	Dependent	Human Error	Test	Unspecified	
High-Pressure Recirculation	20.4	3.0	4.4	--	1.8	--	11.2	4.7-P 1.4-MOV
Auxiliary Foedwater	17.3	1.4	10.4	--	--	.9	4.6	10.4-P
Feed & Bleed	11.9	--	2.2	8.5	1.2	--	--	1.4-PORV .82-BV
Residual Heat Removal	4.2	--	--	4.2	--	--	--	--
Emergency Electric Power	3.6	1.9	--	--	--	--	1.7	1.9-DG
ESF Bus	3.5	--	3.6	--	--	--	--	3.1-DG .27-ESFC .21-EGLSC
MSL Isolation	3.4	3.1	--	--	--	--	.3	3.1-MOV

Table 1.8 Continued

System	% Contribution	Failure Mode Contribution (%)						Component Failure Contribution (%)
		Common Cause	Random	Dependent	Human Error	Test	Unspecified	
Primary Depressurization	3.1	--	--	--	3.1	--	--	--
Low-Pressure Recirculation	3.0	--	--	--	3.0	--	--	--

LEGEND:

P = Pump
MOV = Motor Operated Valve
PORV = Power Operated Relief Valve
BV = Block Valve
DG = Diesel Generator
ESFC = Emergency Safeguard Features Cabinet
EGLSC = Emergency Generator Load Sequencer Cabinet

37.7% (20.4 plus 17.3) because these two systems appear together in some of the same sequences (Sequences 3 and 4). The net effect of reliability improvements for combinations of systems would have to be determined from Table 1.6.

Table 1.8 also provides the failure mode contributions to CMP for component contributions (last column).

Table 1.9 is similar to Table 1.8 and gives information for the latent fatality risk.

From the data in Tables 1.8 and 1.9 the following insights are evident:

- The high-pressure recirculation, auxiliary feedwater, and feed and bleed system failures dominate the core melt probability from leading core melt sequences in descending order of significance. However, none of these systems is a particularly significant contributor.
- Random and dependent failure modes appear to dominate failures of the systems important to CMP, with pumps being the major (but not overly significant) component contributing to failure.
- Quench spray system failure is the most significant system failure contributing to latent fatality risks. This system contributes over 40% to the latent fatalities for the leading sequences.
- Dependent failure is the most important mode contributing to latent fatality risks.
- Early fatality risks result essentially entirely from the contribution of a dependent failure of the residual heat removal system.

1.3 External Events

This section presents a summary of the results of the external events risk analysis from the Millstone 3 PSS. The LLNL review of these results is also considered.

The PSS considered a total of eight external event initiators. These are listed in Table 1.10, with indications of which events were found to be significant contributors to risk and core melt probability. Only two, earthquakes and fires (within the plant), were found to be significant, and only these are considered further in this review (except for the LLNL results).

According to the PSS, the total core melt probability [considering results from Amendment 3][4] from external events is 1.39E-5/yr, of which 9.1E-6 (65%) is from seismic events and the remainder from fires. Thus, external events contribute about 20% to the total CMP. The significance of external events to early and a late fatality risks is shown in Figures 1.1 and 1.2. External events dominate the early fatality risks and have about the same contribution as internal events to latent fatality risks.

Table 1.11 shows the seismic initiated events that dominated core melt probability and latent fatality risks in the PSS assessment. The second

Table 1.9 Summary of System and Component Failures and Failure Mode Contributions to Latent Fatality Risk (Internal Events Only)

System	% Contribution	Failure Mode Contribution (%)						Component Failure Contribution (%)
		Common Cause	Random	Dependent	Human Error	Test	Unspecified	
Quench Spray	42.8	--	--	40.6	2.2	--	--	--
Residual Heat Removal	27.9	--	--	27.9	--	--	--	--
ESF Cabinet	24.4	--	14.2	--	--	7.1	3.1	10-LC 4.2-OR
Auxiliary Feedwater	24.4	--	--	24.4	--	--	--	---
Feed & Bleed	24.4	--	--	24.4	--	--	--	--
Emergency Electric Power	18.4	9.8	--	--	--	--	8.6	9.8-DG
AC Bus	8.0	--	--	--	--	--	8.0	--

LEGEND:

LC = Logic Card
OR = Output Relay
DG - Diesel Generation

Table 1.10 External Event Initiators Considered in the PSS

Event	Significant
Earthquakes	Yes
Fires (inside plant)	Yes
External Flood	No
Internal Flood	No
Extreme Wind	No
Aircraft	No
Hazardous Materials (1)	No
Turbine Missiles	No

(1) Includes storage of on-site materials and transportation of materials near the site.

Table 1.11 Summary of External Event Risks from Seismic Events for Millstone 3

Initiating Event	Containment Response	Frequency Per Year	Contribution to total from all events		
			Core Melt	Early Fatality	Latent Fatality (>1000)
Loss of Off-Site Power	Cooling Failure	5.7E-6	9.5	—	52
Small LOCA	Cooling Failure	1.9E-6	3.2	—	17
Large LOCA	Cooling Failure	6.5E-7	1.1	—	7
LOCA	Isolation Failure	1.0E-7	.2	—	—
	Totals	9.1E-6	14	~0	76

26

column, "Containment Response," indicates the containment function (isolation or cooling) which was lost as part of the sequences associated with the initiating event. The last three columns indicate the percentage that each initiating event and containment response combination contributed to CMP and to early and late fatality risks from seismic events.

The latent fatality column results could not be directly obtained from the Millstone 3 PSS. To derive these values, first the relative significance of external events was determined from Figure 1.2. At 1000 fatalities, the contribution (at the 0.5 confidence level) from external events is about 92% of the total, and at 2000 fatalities, about 94%. Thus, a weighting factor of 0.93 was applied to the external event risks. Of this, about 12%, according to the PSS, is from fire initiated sequences (see Table 1.10). Thus, the contribution from seismic events is about 81%. This factor was multiplied by the product of the latent fatality risk release category contribution and the plant damage state contribution from seismic events given in Table 7.5.1-5 of the PSS. For example, according to Table 7.5.1-5, the M7 release category provides 90% of the seismic risk of latent fatalities. The M7 category is made up of four seismic plant damage states, of which the loss of off-site power with containment cooling failure contributes 71%. Thus, the seismic contribution to latent fatality risk due to this plant damage state is (0.90)(0.71)(0.81) = 0.52, which is the value in Table 1.11.

As Table 1.12 indicates, loss of off-site power with subsequent loss of containment cooling is the dominant contributor to both CMP and late fatality risks. The LOCA event followed by failure of containment isolation dominates the early fatality risks.

Table 1.12 provides a summary of the PSS results for fire initiated accidents. The total CMP from fires represents about 8.4% of the overall CMP as estimated in the PSS from all accidents. Fires in the charging and component cooling pump area and in the cable spreading room are dominant CMP contributors, while latent fatality risks, according to the PSS, are dominated by fire the control room and instrument rack rooms. The latent fatality risk from fires, according to the PSS, represents about 12% of the total from all causes. Fire initiated accidents represent a negligible contribution to early fatalities.

The LLNL review[2] of the PSS external event risk assessment resulted in the following major conclusions:

1. A revision of the PSS assessment of the contribution to CMP from fires led to an increase in the contribution from 4.8E-6 to 2.8E-5 (an increase by a factor of about 5.8). The contribution to latent fatalities, although not explicitly quantified, was judged to be even greater.

2. The PSS does not provide an adequate assessment to support the conclusion that floods are not significant core melt contributors.

3. It is unlikely that winds could be a significant contributor to the CMP.

Table 1.12 Summary of External Event Risks from Fires

Fire Location	Frequency	% Contribution (CMP)
Charging and Component Cooling Pump Area	1.1E-6	1.9
Cable Spreading Room	9.9E-7	1.7
Switchgear Rooms	8.0E-7	1.4
*Control Room	7.3E-7	1.2
Electrical Tunnels	6.9E-7	1.2
*Instrument Rack Room	2.4E-7	.4
Diesel Generator Enclosures	1.45E-7	.2
Totals	4.7E-6	6.1

*These sequences dominate the latent fatality risks from fires and contribute about 12% to the total PSS latent fatality risk.

4. The PSS conclusion that aircraft accidents are not significant contributors to CMP is reasonable.

5. It was not possible to determine whether the screening criteria used to dismiss hazardous material contributors were applied appropriately or consistently.

6. The PSS conclusion that turbine missiles are not significant contributors to plant risk is reasonable.

Based on the preceding discussion of external events, the following insights were derived:

- The PSS determined that of eight different external events considered, only those accidents initiated by internal fires and earthquakes were of significance to CMP or risk.

- External events are a modest contributor to CMP (20%) with seismic events being the major contributor (65% of total).

- Seismic events are a significant contributor to latent fatalities. Fires do not contribute to early fatalities, and only about 12% to the total latent fatality risk.

- The leading seismic initiated accidents contributing to CMP and latent fatalities are those resulting in loss of off-site power with loss of containment cooling.

- The leading fire initiated sequences contributing to CMP are fires in the charging and component cooling pump area and cable spreading room. The leading sequences contributing to latent fatality risk are from fires initiating in the control and instrument rack rooms.

- Major problems found in the LLNL review of the PSS assessment of external events were 1) the CMP from fires is underestimated by a factor of almost six (late fatality risks are also underestimated), and (2) it was not possible to validate the screening criteria used by the PSS for hazardous material risks.

REFERENCES

1. "Millstone Unit 3 Probabilistic Safety Study," Northeast Utilities, August 1983.
2. "A Review of the Millstone 3 Probabilistic Safety Study," NUREG/CR-4142, Lawrence Livermore National Laboratory, May 1984.
3. Probabilistic Risk Assessment (PRA): Status Report & Guidance for Regulation Application, NUREG-1050, USNRC, February 1984.
4. "Millstone Unit 3 Probabilistic Safety Study," Amendment 3, November 28, 1984.

2. INSIGHTS FROM THE SEABROOK STATION PROBABILISTIC SAFETY ASSESSMENT

2.1 Introduction

This section presents an overview of the results from the Seabrook Station Probabilistic Safety Assessment (SSPSA)[1] and selected insights derived from these results. It is not the purpose of this effort to review the SSPSA. Rather, the results are used as is, and the insights are based entirely on these results.

Following a brief overview of the SSPSA results, the leading accident sequences contributing to both core melt probability and risk (of early and late fatalities) are examined in detail to obtain the following insights:

- Relative significance of initiating events.
- System and component failure contributions to leading accident sequences.
- Failure mode (i.e., human error, random, dependent, etc.) contributions to leading accident sequences.

In conjunction with these insights, additional perspective is provided, as appropriate, regarding the relative significance of leading sequences and the different characteristics of the accident sequence "mix" contributing to core melt probability and risk.

The results for internal and external accident initiating events are considered separately.

2.2 Internal Events

This section presents results and insights from internal initiating events. Internal initiators are defined in the SSPSA as loss-of-coolant accidents and transients, where transients are confined to those disruptions listed in Table 2.1.

2.2.1 Overall Results

According to the Summary Report of the SSPSA, the total best-estimate core melt probability is 1.9E-4/reactor year. Based on results given in this Summary Report, the individual risk of early fatalities is about 2E-7/reactor year and for late fatalities (cancer) about 1E-8/reactor year. Figure 2.1, from the SSPSA, shows a distribution of early fatality risks with confidence levels indicated. Figure 2.2 is a similar plot for late fatality risks. Unlike the Millstone 3 PSS, the Seabrook study did not consider internal and external initiating events separately.

2.2.2 Dominant Sequences

Table 2.2 lists accident sequences that are leading contributors to core melt probability, early fatalities (>100), and late fatalities (>1000). It provides some interesting insights relative to the significance of individual

Table 2.1 Seabrook Transient Initiator List

1.	Reactor Trip
2.	Turbine Trip
3.	Total Main Feedwater Loss
4.	Partial Main Feedwater Loss
5.	Excessive Feedwater Flow
6.	Loss of Condenser Vacuum
7.	Closure of One Main Steam
8.	Isolation Valve (MSIV)
9.	Closure of all MSIVs
10.	Core Power Excursion
11.	Loss of Primary Flow
12.	Steam Line Break Inside Containment
13.	Steam Line Break Outside Containment
14.	Main Steam Relief Valve Opening
15.	Inadvertent Safety Injection
16.	Loss of Off-site Power (1)
17.	Loss of One DC Bus (1)
18.	Total Loss of Service Water (1)
19.	Total Loss of Component Cooling Water (1)

(1) Classified in the SSPSA as "Common Cause Initiating Events" (Table 5.2-1)

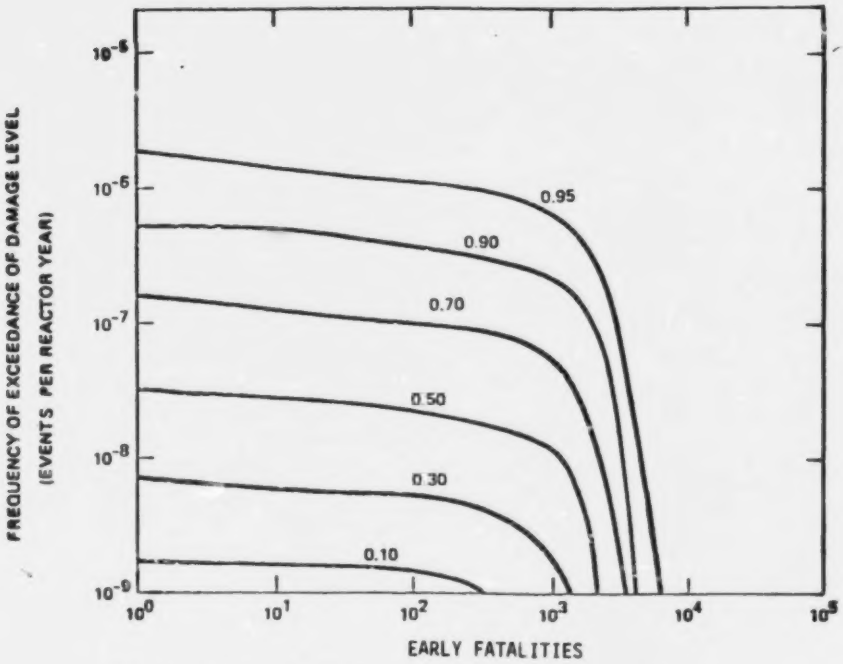

Figure 2.1 SSPSA risk of early fatalities.

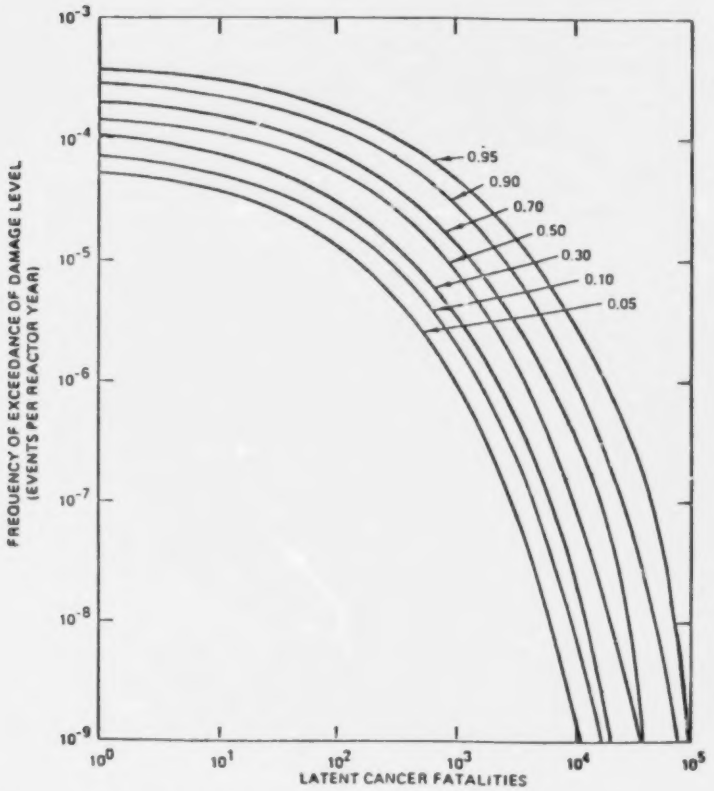

Figure 2.2 Risk of latent cancer fatalities (other than fatal thyroid cancers).

BEST COPY AVAILABLE

Table 2.2 Seabrook Dominant Accident Sequences Contributing to Core Melt, Early Fatalities, and Latent Fatalities for Internal Events

Rank with Respect to Core Melt	Sequence Description	Mean Annual Frequency	Percent Contribution to Core Melt Frequency	Percent Contribution to Early Fatalities (at >100 Fatalities level)	Percent Contribution to Latent Fatalities (at >1000 Fatalities level)
1	Loss of Off-site Power: Loss of On-site AC Power, no Recovery before Core Damage	3.3E-5	14.0	*	5
2	Loss of Off-site Power: Failure of Service Water, no Recovery of Off-site Power	9.2E-6	4.0	*	1.3
3	Small LOCA: Failure of Residual Heat Removal	8.9E-6	3.9	*	*
4	Loss of Main Feedwater: Failure of Solid State of Protection System	8.3E-6	3.5	*	1.2
5	Steam Line Break Inside Containment: Failure of Operator to Establish Long-Term Heat Removal	5.6E-6	2.4	*	*
6	Reactor Trip: Loss of Primary Component Cooling	4.6E-6	2.0	*	3.4
7	Loss of Off-site Power: Failure of Train-A On-site, Train B Service Water, no recovery of Off-site Power before Core Damage	4.4E-6	1.9	*	0.6
8	Loss of Off-site Power: Failure of Train B On-site Power, Train A Service Water, no Recovery of AC Power before Core Damage	4.4E-6	1.9	*	0.6
9	Partial Loss of Main Feedwater: Failure of Primary Component Cooling	3.8E-6	1.7	*	*
10	Loss of One DC Bus: Failure of Emergency Feedwater, no Recovery of Emergency of Startup Feedwater	3.2E-6	1.4	*	*
11	Reactor Trip: Operator Failure to Establish Long-Term Heat Removal	3.0E-6	1.3	*	*

Table 2.2 Continued

Rank with Respect to Core Melt	Sequence Description	Mean Annual Frequency	Percent Contribution to Core Melt Frequency	Percent Contribution to Early Fatalities (at >100 Fatalities level)	Percent Contribution to Latent Fatalities (at >1000 Fatalities level)
12	Turbine Trip: Failure of Primary Component Cooling	2.8E-6	1.2	*	*
13	Loss of Service Water	2.3E-6	1	*	*
14	Partial Loss of Feedwater: Operator Failure to Establish Long-Term Heat Removal	2.3E-6	1	*	*
15	Small LOCA: Train B Safety Features Actuation, Train A Residual Heat Removal	2-2E-6	1	*	*
16	Small LOCA: Train A Safety Features Actuation Train B Residual Heat Removal	2-2E-6	1	*	*
17	Turbine Trip: Failure of Reactor Trip, Failure to Manually Scram and to Effect Emergency Boration	1.9E-6	.8	*	*
18	Interfacing Systems LOCA	1.8E-6	.8	98	17.5
	Totals	1.0E-4	44.8	98	29.6

accident sequences and the mix of sequences contributing to core melt probability vs risk:

- No single sequence makes a very large contribution to core melt probability. The leading sequence contributes only 14% to the total, and the ten leading sequences contribute less than 40% (36.7%).

- A single sequence (interfacing systems LOCA) overwhelms all others with regard to early fatalities, contributing 98% to the total.

- The interfacing systems LOCA sequence also dominates the contribution to late fatalities (17.5%) from internal events. Only two others are significant contributors (greater than 2%).

- The top ten leading contributors to core melt probability contribute only about 12% to late fatalities and a negligible amount to early fatalities.

2.2.3 Initiating Events

Table 2.3, constructed from information in Section 13 of the SSPSA, provides a breakdown of internal event core melt contributors in which accident sequences have been "binned" on the basis of common accident initiating events. It gives the aggregate probability of all sequences in each category. As indicated in the last columns, the categories used contribute essentially 100% to the total SSPSA core melt probability from internal initiating events.

Based on the results in Table 2.3, in conjunction with information in Table 2.2 on early and late risk contributors, the following insights are provided:

- Transients and small LOCAs dominate core melt probability, with transients contributing almost 85% to the total CMP.

- For early fatalities, thhe total probability comes almost entirely (98%) from the contribution of a single sequence which is initiated by an interfacing systems LOCA. For late fatalities, this same sequence dominates, but is less significant than external events (considered later).

2.2.4 System and Component Failures and Failure Modes

The contribution to core melt probability and risk from individual system and component failures, as well as failure modes (human error, dependencies, etc.), were examined.

Table 2.4 lists the contribution from systems and component failures to each of the 12 core melt probability sequences (1 through 12 of Table 2.2). The information was obtained from various sections of the SSPSA and from additional analyses needed to extract individual contributions. It should be emphasized that the breakdown of each system within this table was not derived directly from sequence cut sets. Rather, the breakdown came from the analysis of each individual system. This was necessitated because sequence cut sets

Table 2.3 Dominant Accident Sequences Grouped by Initiating Event (Internal Events Only)

Initiating Event	Accident Sequence Probability	% of Total Internal Event CMP
Transients:		
Loss of Off-site Power	6.88E-5	37.6
ATWS	1.20E-5	6.5
All Others	7.32E-5	40.0
Small LOCA	1.99E-5	10.8
Large LOCA	*	*
Interfacing Systems LOCA	1.84E-6	1.0
Steam Line Break (Inside Containment)	7.29E-6	4.0

* Negligible

Table 2.4 System and Component Failure Contributions to Seabrook Sequences Dominating Core Melt Probability (Internal Events Only)

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
1	14	On-site AC Power	7.4E-3	Random Common Cause Test & Maintenance	57 16 15	Diesel Generators Diesel Generators —	56.2 16 —	One hour is assumed available for recovery
		Reactor Coolant Pump Seal	1	Dependent	100	—	—	
		Cont. Bldg. Sprays	1	Dependent	100	—	—	Two trains
2	4	Service Water	1.1E-2	Common Cause Random	68 22	Pumps (1)	44.8 (1)	It is assumed 9 hrs are available for recovery after SWS failure
		Reactor Coolant Pump Seal	1	Dependent	100	Valves	23.2	
		Cont. Bldg. Sprays	1	Dependent	100	—	—	
3	3.9	Residual Heat Removal	5.5E-4	Common Cause Random Maintenance	50 39 11	Pump (1) —	50 (1) —	

Table 2.4 Continued

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
4	3.5	Solid State Protection System	2.9E-6	Human Error Random	71 29	— (1)	— (1)	
		Reactor Trip	1.0	Dependent	100	—	—	
		Emergency Feedwater	1.0	Dependent	100	—	—	
		High-Pressure Makeup	1.0	Dependent	100	—	—	
		Cont. Bldg. Sprays	1.0	Dependent	100	—	—	
5	2.4	Decay Heat Removal (Long Term)	1.3E-2	Human Error	100	—	—	
6	2.0	Primary Comp. Cooling	1.5E-6	Random	95	Valves	90	
		Reactor Coolant Pump Seal	1.0	Dependent	100	—	—	

Table 2.4 Continued

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
7	1.9	Train A On-site Power	6.2E-2	Random	100	Diesel	82	
		Train B Service Water	1.9E-2	Random	100	MOVs Pumps	60 22	
		Reactor Coolant Pump Seal	1.0	Dependent	100	—	—	
		Containment Sprays	1.0	Dependent	100	—	—	
8	1.9	Train B On-site Power	6.2E-2	Random	100	Diesel	82	
		Train A Service Water	1.9E-2	Random	100	MOVs Pumps	60 22	
		Reactor Coolant Pump Seal	1.0	Dependent	100	—	—	
		Containment Sprays	1.0	Dependent	100	—	—	
9	1.7	Primary Component Cooling	1.5E-6	Random	95	Valves	90	
		Reactor Coolant Pump Seal	1.0	Dependent	100	—	—	

Table 2.4 Continued

Sequence	% C.M. Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
10	1.4	Emergency Feedwater	2.4E-2	(2)	(2)	(2)	(2)	
11	1.3	Decay Heat Removal (Long Term)	1.0E-6	Human Error	100	—	—	
12	1.2	Primary Component Cooling	1.5E-6	Random	95	Valves	90	
		Reactor Coolant Pump Seal	1.0	Dependent	100	—	—	

(1) Component contributions to system failure could not be readily determined for these cases.

(2) Derivation of emergency feedwater unavailability under conditions of this sequence could not be found in the SS PSA.

were not provided. The reader is therefore cautioned that any sequence-dependent failures listed in the table are based upon this review and due to the limited scope of this review the listings may not be exhuastive.

The first column of Table 2.4 identifies the sequence by number corresponding to the Table 2.2 sequences. The second column provides the core melt probability contribution (in percent) from the individual sequences. The third column lists all of the system failures associated with each sequence, and the fourth column gives the probability of each system failure. It is important to note that these probabilities, as provided in the SSPSA, are conditional, that is, dependent upon the initiating event and any preceding system failures. The fifth column provides the failure mode contributions to each of the system failures. Five such modes were identified in the SSPSA: common cause, dependent, random (also called "hardware"), human error, and test and maintenance. As used herein, dependent failures refer exclusively to failures related to the initiating event and preceding system failures.

The sixth column identifies the fractional contribution of each failure mode to the total system failure probability. For example, in Sequence 1, 57% of the failure probability of the on-site ac power system is from random failures and 26% from common cause failures. Note that in many cases (including this example) the column six failure mode contributions do not total to 100%. This is because only those modes found in the SSPSA as dominant contributors are considered. Resources did not permit detailed examination of individual cut sets and fault trees to extract further detail on failure modes for lessor contributors. In nearly all cases, however, the failure modes identified in the sixth column account for over half of the total system failure probability, and for many of the systems the identified failure modes contribute over 90% of the total.

The seventh column identifies the components associated with the relevant failure modes. For the dependent, test and maintenance, and human error modes, no components are identified since for these modes individual component failures are not associated with the system failure. The eighth column provides the individual component contribution to system failure for each failure mode. For example, for Sequence 1, 56.2% of the system failure probability is due to random failures of diesel generators. The last column provides some clarifying information pertinent to the appropriate system.

Table 2.5 gives information similar to that in Table 2.4 for latent fatality risks. As discussed previously, five leading sequences contribute to latent fatality risks. Four of these are also contributors to the core melt probability and therefore the information about them, identical to that in Table 2.4, is not repeated.

From information provided in Table 2.4, Table 2.6 was constructed in order to consolidate the contributions to CMP and risk from systems, failure modes, and components. In Table 2.6, each system is considered separately, as indicated in the first column. The second column lists each sequence (identified in Table 2.2) in which the system appears as a contributor to the sequence probability, and the third column gives the percentage contribution to CMP from each sequence.

Table 2.5 System and Component Failure Contributions to Seabrook Sequences Dominating Latent Fatality Risk (Internal Events Only)

Sequence Number	% Contribution	System Failures	Probability	Dominant Failure Mode Contributions	% of Total	Component Failures	% of Total	Remarks
1	5							
2	1.3							
4	1.2		(See Table 2.4)					
6	3.4							
18	17.5	Residual Heat Removal		Random	100	Valves	100	System failure is also accident initiator

Table 2.6 System and Component Failure and Failure Mode Contributions to Core Melt Probability for Seabrook (Internal Events Only)

System	Seq. No.	% CMP	System Failure Mode Contributions, % (Contribution to CMP- %)					
			Common Cause	Random	Dependent	Human Error	Test and Maintenance	Undetermined or Unspecified
Onsite AC Power	1	14	16 (2.2)-DG	56 (7.8)-DG	--	--	15 (2.1)	13 (1.8)
Service Water	2	8	45 (1.8)-P 23 (.9)-V	32 (1.3)-(1)	--	--	--	
Residual Heat Removal	3	3.9	50 (2.0)-P	39 (1.5)-(1)	--	--	11 (.4)	--
Solid State Protection	4	3.5	--	29 (1)-(1)	--	71 (2.5)	--	--
Decay Heat Removal (Long Term)	5,11	3.7	--	--	--	100 (3.7)	--	--
Primary Component Cooling	6,9,12	4.9	--	90 (4.4)-V	--	--	--	10 (.5)
Onsite AC Power-Train A or B	7,8	3.8	--	82 (3.1)-DG	--	--	--	18 (.7)
Service Water-Train A or B	7,8	3.8	--	60 (2.3)-V 22 (.8)-P	--	--	--	18 (.7)

Table 2.6 Continued

System	Seq. No.	% CMP	System Failure Mode Contributions, % (Contribution to CMP, %)					
			Common Cause	Random	Dependant	Human Error	Test and Maintenance	Undetermined or Unspecified
Emergency Feedwater	10,4	4.9	--	--	--	--	--	100 (4.9)
Reactor Coolant Pump Seal	1,2,6,7 8,9,12	26.9	--	--	100 (26.9)	--	--	--
Reactor Trip	4	3.5	--	--	100 (3.5)	--	--	--
High-Pressure Makeup	4	3.5	--	--	00 (3.5)	--	--	--

The remaining six columns give the failure mode contributions, including an "unspecified" column which provides a quantification of the residual failure mode contribution not readily identified in the SSPSA. For the "common cause" and "random" columns, the component failure contributions to the respective failure modes are identified. The numerical entries (first number) for these columns were obtained from Table 2.4. The number in parentheses is the product of the component failure contribution and the percent contribution of the respective sequence (third column) to the CMP. This value is an absolute measure of the significance of each failure mode and component failure to the CMP.

An example will aid in interpreting Table 2.6. The on-site ac power system appears as a system failure element in one of the CMP leading sequences (No. 1). The total contribution of this sequence to the CMP is 14% (shown under totals in the "% CMP" column). In other words, if the on-site ac power system failure probability could be reduced to 0 under the conditions of the accident sequence, the total CMP calculated by the SSPSA for internal events would be reduced by 14%. For Sequence 1, 16% of the on-site ac power system failure probability derives from common cause diesel generator failures, 56% from random diesel generator failures, etc.

By multiplying these fractions by the core melt contribution (14%), the individual component common cause contribution to core melt probability for Sequence 1 is obtained (these are the values in parentheses: 2.2, 7.8, 2.1, and 1.8). Thus, the "% CMP" for the sequence involving on-site AC power (14%) is made up of a 2.2% contributor from common cause diesel generator failures, 7.8% from random diesel generator failures, 2.1% from test and maintenance, and 1.8% from undetermined or unspecified in the SSPSA. Thus, if it were possible to eliminate common cause failures in the on-site ac power system, the CMP would be reduced by 2.2%, or if random failures in the diesel generators could be eliminated, a 7.8% reduction in the CMP would occur.

Table 2.7 is similar to Table 2.6 and gives the results for latent fatality risks.

Table 2.8 consolidates and summarizes the results of Table 2.6 for system failure, component failure, and failure mode contributions. Table 2.8 lists all systems which appear in the twelve leading CMP sequences and the contribution each system imposes on the total CMP for internal event initiated sequences. Reducing the failure probability to 0 for each system would produce the corresponding reduction in CMP. It should be noted that improving the reliability of combinations of systems would not necessarily produce a benefit equivalent to the summation of the corresponding CMP contributions because more than one of the systems may appear in some sequences.

Table 2.8 also provides the failure mode contributions to CMP for each component contribution (last column).

Table 2.9 is similar to Table 2.8 and gives information for the late fatality risk.

From the data in Tables 2.8 and 2.9, the following insights are evident:

Table 2.7 System and Component Failure Contributions to Latent Risk for Seabrook (Internal Events Only)

System	Seq. No.	% Contribution	System Failure Mode Contributions, % (Contribution to CMP, %)					
			Common Cause	Random	Dependent	Human Error	Test and Maintenance	Undetermined or Unspecified
Residual Heat Removal	18	17.5	--	100 (17.5)-V	--	--	--	--
Onsite AC Power	1	5	16 (.8)-DG	56 (2.8)-DG	--	--	15 (7.5)	13 (.65)
Primary Component Cooling	6	3.4	--	90 (3.1)-V	--	--	--	10 (.34)
Service Water	2	1.3	45 (.6)-P 23 (.3)-V	32 (.4)-(1)	--	--	--	--
Solid State Protection	4	1.2	--	29 (.3)-(1)	--	71 (.9)	--	--
Reactor Coolant Pump Seal	1,2,6	9.7	--	--	100 (9.7)	--	--	--
Cont. bldg. Sprays	1,2,4	7.5	--	--	100 (7.5)	--	--	--
Emergency Feedwater	4	1.2	--	--	100 (1.2)	--	--	--
High-Pressure Makeup	4	1.2	--	--	100 (1.2)	--	--	--

Table 2.8 Summary of System and Component Failures and Failure Mode Contributions to CMP for Seabrook (Internal Events Only)

System	% Contribution	Failure Mode Contribution (%)						Component Failure Contribution (%)
		Common Cause	Random	Dependant	Human Error	Test and Maintenance	Unspecified	
Reactor Coolant Pump Seal	26.9	--	--	26.9	--	--	--	--
Onsite AC Power	14	2.2	7.8	--	--	2.1	1.8	10-DG
Primary Component Cooling	4.9	--	4.4	--	--	--	.5	4.4-V
Emergency Feedwater	4.9	--	--	--	--	--	4.9	--
Service Water	4	2.7	1.3	--	--	--	--	1.8-P .9-V
Residual Heat Removal	3.9	2.0	1.5	--	--	.4	--	2.0-P
Onsite AC Power-Train A or B	3.8	--	3.1	--	--	--	.7	3.1-DG
Service Water Train A or B	3.8	--	3.1	--	--	--	.6	2.3-V .8-P

Table 2.8 Continued

System	% Contribution	Failure Mode Contribution (%)						Component Failure Contribution (%)
		Common Cause	Random	Dependent	Human Error	Test and Maintenance	Unspecified	
Decay Heat Removal (Long Term)	3.7	--	--	--	3.7	--	--	--
Solid State Protection	3.5	--	1	--	2.5	--	--	--
Reactor Trip	3.5	--	--	3.5	--	--	--	--
High-Pressure Makeup	3.5	--	--	3.5	--	--	--	--

Table 2.9 Summary of System and Component Failures and Failure Mode Contributions to Latent Fatality Risk for Seabrook (Internal Events Only)

System	Sequence Number	% Contribution	Failure Mode Contribution (%)						Component Failure Contribution (%)
			Common Cause	Random	Dependent	Human Error	Test and Maintenance	Unspecified	
Residual Heat Removal	18	17.5	—	17.5	—	—	—	—	17.5-V
Reactor Coolant Pump Seal	1,2,6	9.7	—	—	9.7	—	—	—	—
Cont. Bldg. Sprays	1,2,4	7.5	—	—	7.5	—	—	—	—
Onsite AC Power	1	5	.8	2.8	—	—	.75	.65	3.6-DG
Primary Component Cooling	6	3.4	—	3.1	—	—	—	.34	3.1-V
Service Water	2	1.3	.9	.4	—	—	—	—	.6-P .3-V
Solid State Protection	4	1.2	—	.3	—	.9	—	—	—
Emergency Feedwater	4	1.2	—	—	1.2	—	—	—	—
High-Pressure Makeup	4	1.2	—	—	1.2	—	—	—	—

- The reactor coolant pump seal, on-site ac power, primary component cooling, and emergency feedwater system failures are major contributors to the core melt probability from leading core melt sequences in descending order of significance. However, none of these systems is a particularly significant contributor. It should be noted that, in some cases, dependent failures are dominant contributors.

- Random and dependent failure modes appear to dominate failures of the systems important to CMP, with diesel generators being the leading (but not overly significant) component contributing to failure.

- Residual heat removal system failure is the most significant system failure contributing to late fatality risks.

- Random and dependent failures are the most important mode contributing to late fatality risks.

- Early fatality risks (as discussed previously) result essentially entirely from the contribution of a dependent failure of the residual heat removal system.

2.3 External Events

This section presents a summary of the results of the external events risk analysis from the SSPSA.

The SSPSA considered a total of eight external event initiators. These are listed in Table 2.10, with indications of which events were found to be significant contributors to risk and core melt probability. Only two, earthquakes and fires (within the plant), were found to be significant.

According to the SSPSA (Table 13.2-11), the total core melt probability from external events accounts for 20% of the total CMP, of which about 11% is from fires and the remainder (9%) from seismic events.

Table 2.11 shows the seismic initiated events that dominated core melt probability and late fatality risks in the SSPSA assessment. This information was not directly obtainable from the SSPSA results, but was derived by the procedure described in Appendix A. Because of assumptions and methods of estimation, the results are approximate only. The second column of Table 2.11, "Containment Response," indicates the containment function (isolation or cooling) which was lost as part of the sequences associated with the initiating event. The last three columns indicate the approximate percentage that each initiating event and containment response combination contributed to CMP and to early and late fatality risks from seismic events.

As Table 2.11 indicates, loss of off-site power with subsequent failure of containment isolation (<3" openings) is the dominant contributor both to CMP and to early and late fatality risks.

Table 2.12 provides a summary of the SSPSA results for fire initiated accidents. Fires in the control room are dominant CMP and late fatality risk contributors. Fire initiated accidents represent a negligible contribution to early fatalities.

Table 2.10 External Event Initiators Considered in the SSPSA for Seabrook

Event	Significant
Seismic	Yes
Fires (Internal)	Yes
Wind	No
Tornado Missiles	No
Aircraft	No
Hazardous Chemicals	No
Floods	No
Fires (External)	No

Table 2.11 Summary of External Event Risks from Seismic Events for Seabrook

Initiating Event	Containment Response	Frequency Per Year	% Contribution		
			Core Melt	Early Fatality	Late Fatality
Loss of Offsite Power	Small Isolation Failure (<3")	1.7E-5	7.4	~.5	42.9
	Large Isolation Failure (>3")	2.3E-7	*	*	2.6
Failure of Solid State Protection System	Large Isolation Failure (>3")	1.6E-7	*	*	1.8
Totals		1.7E-5	7.4	~.5	47.3

*Negligible

Table 2.12 Summary of External Event Risks from Fires for Seabrook

Fire Location	Frequency	% Contribution		
		CMP	Early Fatalities	Late Fatalities
Control Room	8.7E-6	3.8	*	2.0
Primary Component Cooling Area	4.1E-6	1.8	*	.9
Cable Spreading Room	3.5E-6	1.5	*	.8
Turbine Building	2.3E-6	1.0	*	*
Totals	1.86E-5	8.1	*	3.7

*Negligible

Based on the preceding discussion of external events, the following insights were derived:

- The SSPSA determined that, of eight different external events considered, only those accidents initiated by internal fires and earthquakes were of significance to CMP or risk.

- External events are a modest contributor to CMP (20%), with seismic events contributing about 9% and internal fires about 11%.

- Seismic events are a significant contributor to late fatalities (about 47%). Fires do not contribute to early fatalities, and only about 4% to the total late fatality risk.

- The leading seismic initiated accidents contributing to CMP and late fatalities are those resulting in loss of off-site power with loss of containment isolation.

- The leading fire initiated sequences contributing to CMP and late fatalities are fires in the control room. Fires did not contribute to early fatalities.

REFERENCES

1. "Seabrook Station Probabilistic Safety Assessment," Pickard, Lowe and Garrick, Inc., December 1983.

3. INSIGHTS FROM THE SHOREHAM PROBABILISTIC RISK ASSESSMENT

3.1 Introduction

This section presents an overview of the results from the Shoreham Probabilistic Risk Assessment (PRA)[1] and selected insights derived from these results. It also includes comparative results and insights from a review of the PRA performed by Brookhaven National Laboratory for the NRC.[2] It is not the purpose of this effort to review the PRA or to judge the validity of the BNL review. Rather, the results from both the PRA and the BNL review are used as is, and the insights are provided based entirely on these results.

Following a brief overview of the PRA and BNL results, the leading accident sequences contributing to core melt probability are examined in detail to obtain the following insights:

- Relative significance of initiating events.
- System and component failure contributions to leading accident sequences.
- Failure mode (i.e., human error, random, dependent, etc.) contributions to leading accident sequences.

In conjunction with these insights, additional perspective is provided as appropriate, regarding the relative significance of leading sequences and the different characteristics of the accident sequence "mix" for core melt probability.

The scope of the Shoreham PRA did not include external events except for flooding at elevation 8 of the reactor building. Therefore, the results for internal and external accident initiating events are considered together both here and in the PRA itself. Section 3.3 addresses risk; however, this subject was not fully developed in the PRA.

3.2 Internal Events

This section presents results and insights from internal initiating events. Internal initiators are defined in the PRA as loss-of-coolant accidents, transients and manual shutdowns, initiators coupled with failure to scram, and other low frequency transient events. Transients are confined to those disruptions listed in Table 3.1 and have been grouped into six major categories. Table 3.2 lists the plant-specific low frequency transients.

3.2.1 Overall Results

According to the PRA, the total core melt probability from internally initiated accidents is 5.5E-5/reactor-year. The PRA does not address the individual risk of early and latent fatalities. The BNL review requantified the PRA CMP and arrived at a value of 1.42E-4/reactor-year.

Table 3.1 Summary of the Categories of BWR Transients Used in SNPS-PRA

	Transient Initiator	Group
1.	Electric Load Rejection	T_T
2.	Electric Load Rejection with Turbine Bypass Valve Failure	T_C
3.	Turbine Trip	T_T
4.	Turbine Trip with Turbine Bypass Valve Failure	T_C
5.	Main Steam Isolation Valve Closure	T_M
6.	Inadvertent Closure of One MSIV (Rest Open)	T_T
7.	Partial MSIV Closure	T_T
8.	Loss of normal Condenser Vacuum	T_C
9.	Pressure Regulator Fails Open	T_T
10.	Pressure Regulator Fails Closed	T_T
11.	Inadvertent Opening of a Safety/Relief Valve (Stuck)	T_I
12.	Turbine Bypass Fails Open	T_T
13.	Turbine Bypass or Control Valves Cause Increased Pressure (Closed)	T_T
14.	Recirculation Control Failure -- Increasing Flow	T_T
15.	Recirculation Control Failure -- Decreasing Flow	T_T
16.	Trip of One Recirculation Pump	T_T
17.	Trip of All Recirculation Pumps	T_T
18.	Abnormal Startup of Idle Recirculation Pump	T_T
19.	Recirculation Pump Seizure	T_T
20.	Feedwater -- Increasing Flow at Power	T_T
21.	Loss of Feedwater Heater	T_T

Table 3.1 Continued

	Transient Initiator	Group
22.	Loss of All Feedwater Flow	T_F
23.	Trip of One Feedwater Pump (or Condensate Pump)	T_T
24.	Feedwater -- Low Flow	T_T
25.	Low Feedwater Flow During Startup or Shutdown	T_T
26.	High Feedwater Flow During Startup or Shutdown	T_T
27.	Rod Withdrawal at Power	T_T
28.	High Flux Due to Rod Withdrawal at Startup	T_T
29.	Inadvertent Insertion of Rod or Rods	T_T
30.	Detected Fault in Reactor Protection System	T_T
31.	Loss of Offsite Power	T_E
32.	Loss of Auxiliary Power (Loss of Auxiliary Transformer)	T_T
33.	Inadvertent Startup of HPCI/HPCS	T_T
34.	Scram due to Plant Occurrences	T_T
35.	Spurious Trip via Instrumentation, RPS Fault	T_T
36.	Manual Scram -- No Out-of-Tolerance Condition	T_T
37.	Cause Unknown	T_T

NOTE:

T_T - Turbine Trip
T_C - Loss of Condenser
T_E - Loss of Offsite Power
T_M - MSIV Closure
T_I - Inadvertent Open Relief Valve
T_F - Loss of Feedwater Flow

56

Table 3.2 Other Postulated Low Frequency Transients

	Transient Initiator
1.	Excessive Release of Water into Elevation 8 of the Reactor Building (Sum Over Maintenance Component Failure Initiators).
2.	Loss of DC Power Bus.
3.	Reactor Water Level Measurement System - Reference Line Leak.
4.	Drywell Cooler Failure.
5.	Loss of Service Water.
6.	Loss of AC Power Bus.

3.2.2 Dominant Sequences

Table 3.3, reproduced from Table 5-14 of the BNL Review, lists accident sequences that are leading contributors to core melt probability, based upon the PRA and the BNL review. It provides some interesting insights relative to the significance of individual accident sequences and the mix of sequences contributing to core melt probability:

- In the PRA, no single sequence makes a very large contribution to core melt probability. The leading sequence contributes only 12% to the total, and the 15 leading sequences contribute 55%.
- The BNL results are similar in that the leading sequence contributes only 7% to the total, and the 15 leading sequences contribute 60%.
- It should be noted that the BNL results for percent contribution are calculated on a total CMP different from that in the PRA, and that the top five BNL sequences have a higher frequency than the leading PRA sequence.

3.2.3 Initiating Events

Table 3.4, constructed from information in the BNL review,[2] provides a breakdown of core melt contributors in which accident sequences have been "binned" on the basis of common accident initiating events and early vs late core melt. It gives the aggregate probability of all sequences in each category as estimated by the PRA and by the BNL review, as well as from the fifteen leading sequences of each review found in Table 3.3. As indicated in the fourth and sixth columns, the cate gories used contribute 99.8% to the total PRA core melt probability and 99.3% to the BNL estimate.

The information in Table 3.4 from the total CMP listings was used to establish the relative contribution from important initiating event classes. Table 3.5 gives the data for five initiating event categories. Based on the results in Table 3.5, the following insights are provided:

- Transients overwhelmingly dominate core melt probability with a greater than 95% contribution in both the PRA and BNL review.
- The PRA and BNL reviews were very consistent in this area. The major difference was in the LOCA contribution, for which BNL estimated a lower percentage, but the actual frequencies were close.

3.2.4 System and Component Failures and Failure Modes

The contribution to core melt probability from individual system and component failures, as well as failure modes (human error, dependencies, etc.) were examined. This analysis does not include the BNL review results. Table 3.6 gives the contribution from system and component failures to each of the 15 PRA core melt probability sequences (1 through 15 of Table 3.3). The information was obtained from various sections of the PRA and from additional analyses needed to extract individual contributions. It should be emphasized that the breakdown of each system within this table was not derived directly from sequence cut sets. Rather, the breakdown came from the analysis of each

58

Table 3.3 Leading Sequences for Contribution to CMP from Shoreham PRA and BNL Review (Internal Events)

Leading Sequences	Shoreham PRA Sequence Description	Class/ Subclass	Probability	% CMP	Cumulative % CMP
1. T(M2)C(M)C(2)	MSIV closure transient with failure to scram and failure of one of the standby liquid control system loops.	IV	6.4E-6	12	12
2. T(C)UX	Loss of condenser transient with failure of all high pressure injection systems and failure to depressurize.	IA	2.1E-6	5	17
3. T(T)QUX	Turbine trip with failure of feedwater, all high pressure injection systems, and depressurization.	IA	2.4E-6	5	22
4. T(D)D(I)Q	Loss of a dc bus with failure of the diesel generators for at least two hours and recovery of the offsite power system after 30 minutes as well as a loss of feedwater.	IA	2.2E-6	4	26
5. T(E) IV DUX	Loss of offsite power with recovery in 10 hours, loss of the diesel generators for at least 2 hours, failure of all high pressure injection systems, and failure to depressurize.	IB	2.2E-6	4	30
6. FS(O)QUX	Reactor building flood with failure of feedwater, all high pressure injection systems and depressurization.	ID	1.7E-6	3	33

Table 3.3 Continued

	Leading Sequences	Shoreham PRA Sequence Description	Class/ Subclass	Probability	% CMP	Cumulative % CMP
13.	T(E)W(D)	Loss of offsite power with failure of containment cooling and failure to restore the diesel genertor within two hours.	II	1.1E-6	2	51
14	T(R)RQUX	Loss of level measurement transient with loss of the redundant reactivity control system, loss of feedwater, loss of the HPI function, and failure to depressurize.	IA	1.1E-6	2	53
15.	T(F)C(M)C(2)	Loss of feedwater transient with mechanical failure to scram and failure of one of the standby liquid control system loops.	IV	1.0E-6	2	55

Table 3.3 Continued

Leading Sequences	Shoreham PRA Sequence Description	Class/ Subclass	Probability	% CMP	Cumulative % CMP
7. T(E)III(C)DV	Loss of offsite power with recovery in four hours, failure to scram, failure to recover the diesel generators in two hours, and failure of the low pressure injection function.	IB	1.5E-6	3	36
8. T(F)C(M)U	Loss of feedwater with mechanical failure to scram and failure of the high pressure injection function.	IC	1.5E-6	3	39
9. T(E)C(M)UD	Loss of offsite power with mechanical failure to scram, failure of the high pressure injection function and failure to recover the diesel generator within two hours.	IV	1.5E-6	3	42
10. T(C)W'W"	Loss of condenser transient followed by loss of containment cooling (late melt)..	II	1.5E-6	3	45
11. M(S)QUX	Manual shutdown with failure of feedwater, the high pressure injection function, and depressurization.	IA	1.3E-6	2	47
12. T(E)III(A)DUV	Loss of offsite power for four hours with a large LOCA, diesel generator failure with no recovery in two hours, failure of the high pressure injection function and failure to depressurize.	IB	1.2E-6	2	49

Table 3.3 Continued

	Leading Sequences	BNL Review Sequence Description	Class/ Subclass	Probability	% CMP	Cumulative % CMP
1.	T(T)C(M)K(Q)	Turbine trip with mechanical failure to scram, failure of alternate rod insertion, and failure of feedwater.	IV	1.0E-5	7	7
2.	T(E)IDGL	Loss of offsite power recovered in 30 minutes with failure of the diesel generators, drywell heat removal, and level control.	IB	1.0E-5	7	14
3.	FS(G)QUX	Reactor building flood with failure of feedwater, HPI functions, and depressurization.	IA	~1.0E-5	7	21
4.	T(M)C(M)KU(H)	MSIV closure transient with mechanical failure to scram, failure of alternate rod insertion, failure of HPI function, and operator fails to initiate RHR within two hours.	IV	8.3E-6	6	27
5.	T(T)C(M)KUH	Turbine trip with mechanical failure to scram and failure of alternate rod insertion, HPI function, and operator initiation of RHR in two hours.	IV	6.7E-6	5	32
6.	T(E)IV D	Loss of offsite power with recovery in 10 hours, and failure of the diesel generators to be recovered within two hours.	IB	6.7E-6	5	37

Table 3.3 Continued

	Leading Sequences	BNL Review Sequence Description	Class/ Subclass	Probability	% CMP	Cumulative % CMP
7.	T(T)QUX	Turbine trip with failure of feedwater, HPI function, and depressurization.	IA	5.5E-6	4	41
8.	T(T)C(M)C(2)	Turbine trip with mechanical failure to scram and failure of one standby liquid control system loop.	IV	4.2E-6	3	44
9.	T(C)UX	Loss of condenser with failure of HPI function and failure to depressurize.	IA	4.2E-6	3	47
10.	T(T)C(M)U(H)	Turbine trip with mechanical failure to scram and failure of HPI function and failure of operator to initiate RHR within two hours.	IV	3.9E-6	3	50
11.	T(E)IIIDUX	Loss of offsite power with recovery in four hours and failure to recover diesel generators within two hours, failure of HPI function, and failure to depressurize.	IB	3.3E-6	2	52
12.	T(SW)TSUV	Loss of service water with failure to crosstie turbine building service water and the unavailability of the power conversion system (for both injection and heat sink functions), the failure of HPI function and failure of LPI functions.	ID	2.6E-6	2	54
13.	T(SW)TSUX	Same as above except that instead of failure of the LPI function there is failure to depressurize.	IA	2.6E-6	2	56

Table 3.3 Continued

	Leading Sequences	BNL Review Sequence Description	Class/ Subclass	Probability	% CMP	Cumulative % CMP
14.	T(M)QUX	MSIV closure transient with failure of feedwater, HPI functions, and depressurization.	IA	2.5E-6	2	58
15.	T(C)W	Loss of condenser with failure of containment heat removal functions.	II	2.5E-6	2	60

Table 3.4 Accident Sequences for Shoreham Grouped by Initiating Event and Timing (Internal Only)

Sequence Type	CD Class	SNPS Total	% Total	BNL Total	% Total	SNPS Leading Sequences	% Total	BNL Leading Sequences	% Total
Loop (Driven) Transients	IB	9.9E-6	17.8	2.9E-5	20.4	4.9E-6	8.8	2.0E-5	14.3
ATWS (Driven) Transients	IC	4.0E-6	7.19	-	0	1.5E-6	2.7	-	0
Other CD Class I Transients	IA & ID	1.81E-5	32.5	5.26E-5	37.0	1.18E-5	21.2	2.74E-5	19.6
LOCA, Late	II_{LOCA}	1.0E-6	1.8	5.3E-7	.37	-	0	-	0
Transient, Late	$II_{TRANSIENT}$	7.50E-6	13.48	1.25E-5	8.8	2.6E-6	4.7	2.5E-6	1.8
LOCA	III	1.0E-6	1.8	1.3E-6	.91	-	0	-	0
ATWS/Containment Failure	IV	1.4E-5	25.16	4.5E-5	31.7	9.9E-6	16.0	3.31E-5	23.6
LOCA Outside Drywell	V	3.7E-8	.067	2.0E-7	.10	-	0	-	0
TOTALS		5.6E-5	99.8	1.4E-4	99.28	2.9E-5	53.4	8.3E-5	59.3

Table 3.5 Initiating Event Categories Contribution to Core Melt (Internal)

Initiator	% Contribution to CMP	
	Shoreham	BNL
LOCA	3.6	1.28
LOCA Outside Drywell	0.067	0.1
ATWS	32.35	31.7
LOOP	17.8	20.4
Other Transients	45.98	45.8
Totals	99.8	99.28

Table 3.6 System and Component Failure Contributions To Shoreham Leading CM Sequences

Sequence	% CM Contribution	System Failures	Probability	Dominant Failure Contribution	% of Total	Component Failures	% of Total
1. T(M2)C(M)C(2)	11.5	SCRAM	1E-5	Common Cause	100	Control Rods	100
		SLC	1.05E-1	Human	95.2	-	-
2. T(C)UX	5.6	RCIC	6.873E-2	Test and Maintenance	16	-	-
				Random	64	Pressure Sensors	8.7
						Temperature Elem.	37.8
						MOV's	17.5
		HPCI	9.63E-2	Test and Maintenance	10.4	-	-
				Human	13.5	-	-
				Random	45.5	Pump and Turbine	15.5
						MOV's	30
		ADS	8.56E-4	Common Cause	47	Solenoid Valves	35
						Contam. Air Supply	12
				Human	33		
3. T(T)QUX	4.3	Feedwater	5.46E-2	Common Cause	11		
				Human	58.6		
				Random	4.4	Pressure Sensors	4.4
		RCIC*					
		HPCI*					
		ADS*					
4. T(D)D(I)Q	4.1	Diesels	3.8x10-3	Common Cause	90		
				Random	10		
		Feedwater*					

*Analyzed Above

Table 3.6 Continued

Sequence	% CM Contribution	System Failures	Probability	Dominant Failure Contribution	% of Total	Component Failures	% of Total
5. T(E)IVDUX	4.1	LPCS	3.62E-3	Human	58	-	-
				Common Cause	13.5	Pumps (Motor-driven)	100
				Dependent	7.1		
				Test and Maintenance	3.9	-	-
		LPCI	2.68E-3	Human	82	-	-
				Dependent	9.7		
				Test and Maintenance	5.2		
		Diesels*					
		HPCI*					
		RCIC*					
		ADS*					
6. FS(O)QUX	3.0	Feedwater*					
		HPCI*					
		RCIC*					
		ADS*					
7. T(E)IIICDV	2.7	SCRAM*					
		Diesels*					
		LPCS*					
		LPCI*					
8. T(F)C(M)U	2.7	SCRAM*					
		HPCI*					
		RCIC*					

*Analyzed Above

GX

Table 3.6 Continued

Sequence	% CM Contribution	System Failures	Probability	Dominant Failure Contribution	% of Total	Component Failures	% of Total
9. T(E)C(M)UC	2.7	SCRAM* HPCI* RCIC* Diesels*					
10. T(C)W'W"	2.7	RCICSC	1.4E-1	Human	37	-	-
				Random	7.5	MOVs	5.7
		RHR	4.83E-4	Dependent	54	Pressure Sensors	1.8
				Test and Maintenance	29	-	-
		Condensate	1.23E-1	Common Cause	7.3	Pumps	100
				Human	20	-	-
				Dependent	1		
11. M(S)QUX	2.3	Feedwater* HPCI* RCIC* ADS*					
12. T(E)III(A)DUV	2.2	Diesels* HPCI* RCIC* LPCI* LPCS*					

*Analyzed Above

Table 3.6 Continued

Sequence	% CM Contribution	System Failures	Probability	Dominant Failure Contribution	% of Total	Component Failures	% of Total
13. T(E)W(D)	2	RHR* Condensate* Diesels*					
14. T(R)RQUX	2	Feedwater* HPCI* RCIC* ADS*					
15. T(F)C(M)C(2)	1.8	SCRAM* SLCS*					

*Analyzed Above

individual system. This was necessitated because sequence cut sets were not provided. The reader is therefore cautioned that any sequence-dependent failures listed in the table are based upon this review and due to the limited scope of this review the listings may not be exhaustive.

The first column of Table 3.6 identifies the sequence by number and designation corresponding to the Table 3.3 sequences. The second column provides the core melt probability contribution (in percent) from the individual sequences. The third column lists all of the system failures associated with each sequence, and the fourth column gives the probability of each system failure. It is important to note that these probabilities, as provided in the PRA, are conditional, that is, dependent upon the initiating event and any preceding system failures. The fifth column provides the failure mode contributions to each of the system failures. Five such modes were identified in the PRA: common cause, dependent, random, human error, and test. As used herein, dependent failures refer exclusively to failures related to the initiating event and preceding system failures.

The sixth column identifies the fractional contribution of each failure mode to the total system failure probability. For example, in Sequence 1, 95.2% of the failure probability of the standby liquid control system is from human error and the remainder is not specified. Note that in many cases (including this example) the column six failure mode contributions do not total to 100%. This is because only those modes identified in the PRA as dominant contributors are considered. Resources did not permit detailed examination of individual cut sets and fault trees to extract further detail on failure modes for lesser contributors. In nearly all cases, however, the failure modes identified in the sixth column account for over half of the total system failure probability, and for many of the systems the identified failure modes contribute over 90% of the total.

The seventh column identifies the components associated with the relevant failure modes. For the dependent and human error modes, no components are identified since for these modes individual component failures are not associated with the system failure. The eighth column provides the individual component contribution to system failure for each failure mode. For example, for Sequence 1, essentially 100% of the scram system failure probability is due to common mode failure of the control rods to insert.

From information provided in Table 3.6, Table 3.7 was constructed in order to consolidate the contributions to CMP from systems, failure modes, and components. In Table 3.7, each system is considered separately, as indicated in the first column. The second column lists the number of sequences (identified in Table 3.3) in which the system appears as a contributor to the sequence probability, and the third column gives the aggregate percentage contribution to CMP from these sequences.

The remaining six major columns give the failure mode contributions, including an "unspecified" column which provides a quantification of the residual failure mode contribution not specified in the PRA. For the "common cause" and "random" columns, the component failure contributions to the respective failure modes are identified. The numerical entries for these columns were obtained by taking the product of the component failure or failure mode contribution from Table 3.6 and the percent contribution of the

Table 3.7 Total System and Component Failure Contributions from Leading Cut Sets

SYSTEM	# OF SEQs.	% CMP	COMMON CAUSE						RANDOM					HUMAN ERRORS	TEST & MAINT.	UNSPEC.	DEPENDENT
			Overall %	Control Rods	Solenoid Valves	Contam. Air Supply	Motorized Pumps	Unspec.	Overall %	Pressure Sensors	Temp. Elem.	MOV's	Turbine & Pump				
SCRAM	5	21.4	21.4	21.4										12.66		0.64	
SLC	2	13.3							20.22	2.75		5.53			5.06	6.32	
RCIC	10	31.6							13.15			8.67	4.48	3.9	3.0	8.84	
HPCI	9	28.9												7.03		4.26	
ADS	6	21.3	10.0		7.45	2.56								9.2		4.08	
FEEDWATER	5	15.7	1.73					1.73	0.69	0.69						1.78	
DIESELS	6	17.8	16.02					16.02						5.22	0.35	1.58	0.64
LPCS	3	9.0	1.22				1.22							7.38	0.47	0.28	0.87
LPCI	3	9.0												1.0		1.5	
RCICSC	1	2.7							0.20	0.05		0.15			1.36	0.46	2.54
RHR	2	4.7	0.34				0.34							0.94		3.71	0.05
CONDENSATE	2	4.7												47.33	10.24	32.87	4.1
TOTALS			50.71	21.4	7.45	2.56	1.56	17.75	34.26	3.49	11.85	14.35	4.48				

BEST COPY AVAILABLE

respective sequence (third column of Table 3.7) to the CMP. This value is an absolute measure of the significance of each failure mode and component failure to the CMP.

An example will aid in interpreting Table 3.7. The reactor core isolation cooling system (RCIC) appears as a system failure element in ten of the CMP leading sequences. The total contribution of these ten sequences to the CMP is 31.6% (shown under the "% CMP" column). In other words, if the RCIC failure probability could be reduced to 0 under the conditions of the ten accident sequences, the total CMP calculated by the PRA would be reduced by 31.6%. For the ADS, 47% of its failure probability derives from common cause failures, of which 35% are common cause SOV failures and 12% arise from contaminated air supplies (Table 3.6). By multiplying these fractions by the core melt contribution (Column 3), the individual component common cause contribution to core melt probability is obtained.

Tables 3.8, 3.9, and 3.10 consolidate and summarize the results of Table 3.7 for failure mode, system failure, and component failure contributions to CMP, respectively. Table 3.9 lists all systems which appear in the 15 leading CMP sequences and the contribution each system imposes on the total CMP for internal event initiated sequences. Reducing the failure probability to 0 for each system would produce the corresponding reduction in CMP. It should be noted that improving the reliability of combinations of systems would not necessarily produce a benefit equivalent to the summation of the corresponding CMP contributions because more than one system appears in some sequences. The net effect of reliability improvements for combinations of systems would have to be determined from Table 3.6.

From the data in Tables 3.8, 3.9, and 3.10, the following insights are evident:

- The reactor core isolation cooling and high pressure coolant injection system failures dominate the core melt probability from leading core melt sequences in that order. However, neither of these systems is a particularly significant contributor.

- Common cause failure appears to dominate failures of the systems important to CMP, however, this is driven by the major role of ATWS in the leading CMP sequences.

- Human error contributes almost 50% (47.33%) of the overall CMP.

- With respect to failure to scram, it is clear that the assumptions made about scram failure probability and the total dominance by CMF of the control rods drive the conclusions derived from Tables 3.5, 3.7, 3.8, 3.9, and 3.10. The PRA states that these assumptions were taken directly from NUREG-0460 and that their own evaluation of the specific Shoreham design (not used in the PRA) would reduce the scram system contribution to CMP to around 10%. This could have a large impact on the insights derived from the above tables.

Table 3.8 Failure Mode Contribution to CMP from Leading Cut Sets

FAILURE MODE	% CONTRIBUTION
COMMON CAUSE	50.71
HUMAN	47.33
RANDOM	34.26
UNSPECIFIED	32.87
TEST & MAINTENANCE	10.74
DEPENDENT	4.1

Table 3.9 System Contribution to CMP from Leading Cut Sets

SYSTEM	% CONTRIBUTION
RCIC	31.6
HPCI	28.9
SCRAM	21.4
ADS	21.3
DIESELS	17.8
FEEDWATER	15.7
SLC	13.3
LPCS	9.0
LPCI	9.0
RHR	4.7
CONDENSATE	4.7
RCICSC	2.7

Table 3.10 Component Contribution to CMP from Leading Cut Sets

COMPONENT	% CONTRIBUTION
CONTROL RODS	21.4
MOVs	14.35
TEMP. ELEMENTS	11.85
SOLENOID VALVES	7.45
TURBINE & PUMP	4.48
PRESSURE SENSORS	3.49
MOTORIZED PUMPS	1.56

3.3 Risk

Long Island Lighting Company divided the PRA effort into three phases: 1) the probabilistic evaluation of event sequences; 2) was an in-plant consequence evaluation, and 3) the ex-plant consequence evaluation. The results of Phase 1, i.e., the core melt probabilities, are addressed in Section 3.2, above. This section would normally address the results of Phase 3, but Phase 3 is not a part of the published PRA. Therefore, the results of Phase 2 are briefly addressed although this is not a satisfactory substitution for Phase 3 results. Phase 2 of the PRA was not included in the BNL PRA review.[2]

The PRA allocated the core melt sequences into 16 release categories, the parameters of which are defined in Table 3.11 (Table 5.3.2 of the PRA). The severe potential radiological impacts and frequencies are summarized in Table 3.12 (from Table 2 of the PRA), which shows that only three of the 16 release categories have been designated as severe (7, 13, and 14). These are described in Table 3.13. The PRA defines its qualitative measures of radiological impact as follows:

> Severe -- the entire core inventory of the noble gases is released, and large fractions of the volatiles and particulates are released.
>
> Moderate -- a large fraction of the noble gases and some fraction of the volatiles and particulates are released.
>
> Minor -- primarily noble gases are released, and small fractions of the volatiles and particulates are released; this implies that very long warning times are available to implement protective actions to mitigate the effects of the release.
>
> Negligible -- a very small fraction of the fission products is released since core melt is arrested, or the containment leakage is very slow; this also implies that protective actions may not be required.

The following insights are offered based on the foregoing:

- The three "severe" release categories represent about 0.33% of the total core melt probability and expectedly have the shortest warning times.
- These three release categories would be expected to dominate early fatalities.
- Interfacing systems LOCA is included in the severe category, but it does not appear to dominate as it does in some of the other studies.

REFERENCES

1. "Probabilistic Risk Assessment Shoreham Nuclear Power Station," Long Island Lighting Co./SAI, June 1983.
2. "A Review of the Shoreham Nuclear Power Station Probabilistic Risk Assessment," NUREG/CR-4050, Brookhaven National Laboratory, June 1985.

Table 3.11 Summary of Release Parameters for Ex-Plant Consequences

RELEASE CATEGORY	ESTIMATED FREQUENCY PER REACTOR YR.	TIME OF RELEASE, HRS.	DURATION OF RELEASE, HRS.	WARNING TIME FOR PROTECTIVE ACTION, HRS.	ELEVATION OF RELEASE, METERS	CONTAINMENT ENERGY OF RELEASE, 10^6 Btu/hr
1	2.0×10^{-7}	2.5	2.5	2	60,	5
2	2.0×10^{-6}	2.5	2.5	2	60	5
3	2.3×10^{-6}	23.5	0.5	22	60	30
4	5.9×10^{-6}	23.5	0.5	22	60	30
5	6.3×10^{-7}	38.0	2.5	34	60	50
6	1.2×10^{-6}	38.0	2.5	34	60	50
7	1.5×10^{-7}	1.5	2.5	1	60	20
8	6.1×10^{-7}	26.5	0.5	25	60	30
9	6.7×10^{-7}	26.5	0.5	25	60	30
10	3.1×10^{-6}	2.5	1.0	2	60	60
11	3.8×10^{-6}	2.5	1.0	2	60	60
12	6.3×10^{-6}	2.5	1.0	2	60	60
13	2.5×10^{-8}	1.5	2.0	1	60	6
14	1.1×10^{-8}	1.5	2.0	1	60	6
15	8.3×10^{-6}	2.5	---	--	60	--
16	1.9×10^{-6}	2.5	---	--	75	--

BEST COPY AVAILABLE

Table 3.12 Summary of Shoreham Release Categories with Potentially Severe Radiological Impact

Release Category	Accident Classes Contributing to Release Category	Potential Radiological Impact	Frequency of Release
7	III	Severe	1.5×10^{-7}
13	V	Severe	2.5×10^{-8}
14	V	Severe	1.1×10^{-8}

Table 3.13 Description of the Severe Release Categories Identified by the Shoreham PRA

Release Category	General Description	Dominant Accident Sequence Contribution Basis For In-Plant Analysis
7	This release category is representative of a Class III accident sequence in which the containment fails early in the accident sequence due to inadequate pressure suppression capability. The fission products released from the core region are discharged directly to the drywell atmosphere and are not significantly attenuated prior to leakage from the drywell. This category includes Large LOCA and RPV failure accident sequences, which challenge containment integrity early in the sequence.	Large LOCA, failure of vapor suppression, early overpressure failure of containment.
13	This release category is representative of Class V accident sequences which involve core meltdown following a LOCA outside containment. The SRVs are actuated in order to mitigate the release of fission products to the environment by providing an alternative path into the containment (i.e., suppression pool) during the in-vessel release period.	Interfacing LOCA, the suppression pool is partially effective in mitigating releases.
14	This release category is representative of Class V accident sequence which involve core meltdown following a LOCA outside containment. The SRVs are assumed not to be opened, and the fission products released from the fuel totally bypass the containment.	Interfacing LOCA, failure of SRVs.

4. INSIGHTS FROM THE OCONEE 3 PROBABILISTIC RISK ASSESSMENT

4.1 Introduction

This section presents an overview of the results from the Oconee 3 Probabilistic Risk Assessment (PRA)[1] and selected insights derived from these results. The review of the PRA being done by Brookhaven National Laboratory for the NRC was not completed at the time this study was undertaken. It is not the purpose of this effort to review the PRA or to judge its validity. Rather, the results from the PRA are used as is, and the insights are based entirely on these results.

Following a brief overview of the PRA, the leading accident sequences contributing to both core melt probability and risk (of early and late fatalities) are examined in detail to obtain the following insights:

- Relative significance of initiating events.
- System and component failure contributions to leading accident sequences.
- Failure mode (i.e., human error, random, dependent, etc.) contributions to leading accident sequences.

In conjunction with these insights, additional perspective is provided, as appropriate, regarding the relative significance of leading sequences and the different characteristics of the accident sequence "mix" for core melt probability and risk.

The core melt probability results for internal and external accident initiating events are considered separately, in Sections 4.2 and 4.3. This is in accordance with discussions in the PRA reference document[2] and is also consistent with a similar separation in the PRA itself. Both internal and external events were combined in the PRA in developing the public risk assessment, and they are combined also in Section 4.4.

The Oconee PRA identified turbine building flooding as the dominant initiator within the PRA study; as a result, the plant was modified and certain aspects of the PRA were requantified. It is important to keep in mind that the published PRA contains a mix of pre- and post-modification quantification and that in this study the post-modification information was used whenever available and, whereever a mix of data was used, the distinction was noted.

4.2 Internal Events

This section presents results and insights from internal initiating events. Internal initiators are defined in the PRA as loss-of-coolant accidents and transients. These initiating events are listed and defined in Table 4.1 (reproduced from Table 3.5 of the PRA).

4.2.1 Overall Results

The total core melt probability from internally initiated accidents is 5.4E-5/reactor year. For Oconee, this represents only 21.3% of the total

Table 4.1 Internal Initiating Events for the Oconee PRA

Event	Description
LOSS-OF-COOLANT ACCIDENTS	
S: Small-break LOCA	A break or leak 1/2 to 4 inches in effective diameter. These are spontaneous events: induced LOCAs were treated directly.
A: Large LOCA	A break or rupture greater than 4 inches in effective diameter except those noted below.
A_I: Interfacing-system LOCA	A large loss of coolant through the valves acting as a boundary between high and low RCS pressure.
RPV RUPTURE: Vessel rupture	A loss of reactor-vessel integrity precluding the ability to maintain coolant inventory.
S_{SG}: Steam-generator tube rupture	A rupture of a steam-generator tube resulting in an RCS leak greater than 100 gpm.
TRANSIENT EVENTS	
T_1: Reactor/turbine trip	An event resulting in reactor trip but not significantly degrading the operability of equipment needed to respond to the event.
T_2: Loss of main feedwater	An interruption of main-feedwater flow from both trains of the system. Some events resulting in a loss of main feedwater are treated separately as defined by other transients.
T_3: Partial loss of main feedwater	A degradation of the feedwater system sufficient to cause a trip but not precluding an immediate feedwater response after the trip. Failure of one main-feedwater pump is an example.
T_4: Loss of condenser vacuum	A reduction of condenser vacuum to a level resulting in a feedwater-pump trip. Recovery of this event considers the level of degradation caused by the potential initiating events.
T_{5subF}: Failure of offsite power at the substation	Substation fault resulting in plant isolation from the electrical grid.

80

Table 4.1 Continued

Event	Description
TRANSIENT EVENTS (continued)	
T_{5FEEDF}: Failure of electrical grid or main feeders	Failure of the local grid or feeders resulting in a loss of power to the plant.
T_6: Loss of instrument air	A reduction in instrument-air pressure to a level where valves and instruments cannot provide their intended function. A 10-minute loss resulting in plant trip was assumed for the calculated T6 frequency.
T_7: Excessive feedwater	Feedwater events leading to the overfilling of a steam generator and hence an overcooling transient.
T_8: Spurious engineered-safeguards signal	A spurious initiation of safeguards equipment. The effect specifically modeled is the initiation of HPI flow.
T_9: Steamline break	A rupture of a large secondary steamline. Effects of breaks inside and outside containment were detailed.
T_{10}: Feedline break	Failure of a major feedwater line resulting in failure of main feedwater.
T_{11}: Loss of ICS power bus KI	Failure of power provided by bus KI to the ICS.
T_{12}: Loss of service water	Failure of the LPSW system resulting in insufficient flow in the main headers or failure to vital equipment.
$T_{12(108)}$: Loss of service water due to transfer of LPSW-108	Failure of the LPSW system due to the specific failure mode involving valve LPSW-108. This is a subset of T_{12}, treated differently for recovery actions.
T_{13}: Spurious low-pressurizer-pressure signal	Incorrect instrument measurement of pressurizer pressure. Sensed signal is lower than the true value.
T_{14}: Loss of power to bus 3TC	Failure of bus or switchgear 3TC resulting in power loss to many plant loads. Plant and main-feedwater trip are the first effects.

(internal + external) core melt probability. The significance of internally initiated events to early and late fatality risks is discussed in Section 4.4.

4.2.2 Dominant Sequences

Table 4.2 lists the accident sequences that are leading contributors to core melt probability. It provides the following insight relative to the significance of individual accident sequences:

- The top 12 sequences provide 82% of the contribution to core melt probability. The leading sequence contributes 24% to the total, and is three times as probable as any of the others.

4.2.3 Initiating Events

Table 4.3 provides a breakdown of total core melt contributors on the basis of accident initiating events. This information was used to establish the relative contribution from important initiating event classes. The results are given in Table 4.4, in which four initiating event categories are used. Based on these results, the following insights are provided:

- Transients dominate core melt probability.
- Loss of service water contributes nearly one quarter of the CMP.
- Large LOCA contributes about 1.5 times as much as small LOCA.

4.2.4 System and Component Failures and Failure Modes

The contribution to core melt probability from individual system and component failures, as well as failure modes (human error, dependencies, etc.), were examined. Table 4.5 shows the contribution from system and component failures to each of the listed core melt sequences. This information was obtained directly from the PRA by examining the leading cut sets of each sequence. The Oconee PRA was unique in that this information was provided directly by sequence and thus a much more accurate extraction of the data for Table 4.5 was possible than for the other PRAs examined in this study. Note that the eleven sequence types in Table 4.5 do not correspond exactly to the top twelve sequences in Table 4.2. This is the result of a further binning process whereby similar sequences were combined into a single sequence type within a plant damage bin. For example, Sequence 1 in Table 4.2 represents only LPSW as the initiating event whereas Sequence 1 in Table 4.5 also includes some loss of ac power events that in turn fail LPSW. As this latter configuration of sequences was presented in the PRA with accompanying leading cut sets, these sequences were the ones analyzed. As it turns out, the binning process yields eleven sequence types contributing 85% of the total core melt probability from internal events.

The first column of Table 4.5 identifies the sequence by number and designator. The second column provides the core melt probability contribution, in percent, from the individual sequence and in parenthesis the percent by weight of the cut sets examined. The third column lists all of the system failures associated with each sequence. The fourth column gives the contribution in percent to the total CMP, i.e., column 2 times the parenthetical

Table 4.2 Leading Sequences for Contribution to CMP - Oconee 3 (Internal Events)

	Leading Sequences	Sequence Description	Probability	% CMP	Cumulative % CMP
1.	$T_{12}BU$	Failure of LPSW fails HPI pumps unless operator action and failure to initiate SSF seal injection leads to RCS leak with no make-up	$1.3x10^{-5}$	24	24
2.	SY_SX_S	SBLOCA with successful HPI. LOCA actuates RBSS and either operator fails to terminate of RBCS is unavailable and RBSS must be left on. HPR fails to be initiated successfully upon depletion of BWST.	$5.0x10^{-6}$	9	33
3.	$T_{10}BU$	Large feedwater line break causes loss of MFW and EFW. Feedwater from other sources fails to be initiated and HPI cooling fails.	$4.8x10^{-6}$	9	42
4.	AX_A	Failure of LPR to initiate or run after large LOCA.	$4.8x10^{-6}$	9	51
5.	AX_A	Large LOCA with successful injection. High flow develops in LPR leading to pump cavitation and failure if not remedied.	$3.3x10^{-6}$	6	57
6.	T_6BU	Loss of instrument air resulting in loss of MFW. Failure of EFW, failure to recover feedwater, and HPI cooling fails.	$3.2x10^{-6}$	6	63
7.	TWS	ATWS (turbine trip), MFW fails and either injection or long term cooling fails.	$2.8x10^{-6}$	5	68
8.	T_5BU	Loss of offsite power resulting in loss of instrument air and MFW. Failure of EFW, failure to recover feedwater and HPI cooling fails.	$2.4x10^{-6}$	4	72
9.	TWS	ATWS (turbine trip), moderator temperature coefficient less than 95% yields large pressure transient with resulting LOCA. Injection systems fail to provide makeup.	$1.7x10^{-6}$	3	75

Table 4.2 Continued

Leading Sequences		Sequence Description	Probability	% CMP	Cumulative % CMP
10.	TWS	ATWS (turbine trip), same as sequence 9 above except that long term cooling fails following successful injection.	1.5×10^{-6}	3	78
11.	T_2BU	Loss of MFW followed by failure of EFW and HPI cooling.	1.2×10^{-6}	2	80
12.	VR	Reactor vessel rupture.	1.1×10^{-6}	2	82

Table 4.3 Mean Annual Core Melt Frequencies for Internal Initiating Events[a]

		% CMP
Loss of service water	1.3-5	24.06
Large-break LOCA	9.0-6	16.65
Small-break LOCA	6.1-6	11.29
Transient without scram	6.0-6	11.10
Feedwater-line break	4.8-6	8.88
Loss of instrument air	3.2-6	5.92
Steam-generator tube rupture	2.7-6	5.00
Loss of offsite power	2.4-6	4.44
Turbine/reactor trip	1.8-6	3.33
Loss of main feedwater	1.2-6	2.22
Other transients	2.6-6	4.81
Reactor-vessel rupture	1.1-6	2.04
Interfacing-system LOCA	1.4-7	0.26
Total	5.4-5	100.00

[a]Based on analysis of the unmodified plant.

Table 4.4 Internal Initiating Event Categories--Contribution to Core Melt Probability

Initiator	Probability	% Contribution to Internal CMP
Transients	3.5E-5	64.77
LOCA	1.62E-5	29.98
St. Gen. Tube Rupt.	2.7E-6	5.00
Interfacing LOCA	1.4E-7	0.26
Totals	5.4E-5	100.00

Table 4.5 System and Component Failure Contributions to Oconee 3 Sequences Dominating Core Melt Probability (Internal Events)

Sequence	% CM Cont. (% Cut Sets Ex)	System Failures	Leading Cut Set Contributions % Total CMP	Seq. Related Dominant Failure Mode Contributors	% Total CMP	Sequence Related Component Failures	% Total CMP
1. $T_{12}BU$	28 (97.53)	LPSW	27.31 (97.53)	Dependent	1.12 (4.0)		
				Random	26.18 (93.5)	MOV	16.35 (58.4)
		HPI	27.31 (97.53)	Dependent	27.31 (97.53)		
2. SY_SX_S	9 (99.3)	HPR	8.937 (99.3)	Human	8.26 (91.8)		
				Random	0.61 (7.5)		
3. $T_{10}BU$	9 (97.9)	MFW	8.81 (97.9)	Dependent	8.81 (97.9)		
		EFW	8.81 (97.9)	Dependent	8.81 (97.9)		
		HPI	8.81 (97.9)	Human	8.81 (97.9)		
4. AX_A	9 (98)	LPR	8.82 (98)	Human	8.82 (98)		
5. T_6BU	9 (98.6)	HPI	8.87 (98.6)	Human	8.87 (98.6)		
		MFW	8.87 (98.6)	Dependent	8.87 (98.6)		
		EFW	8.87 (98.6)	Dependent	6.25 (69.4)		
				Random	2.63 (29.2)	UST	2.63 (29.2)
6. AX_A	6 (97.6)	LPR	5.86 (97.6)	Human	5.09 (84.8)		
				Dependent	0.7 (11.6)		
				Random	0.07 (1.2)	MOV	0.07 (1.2)
7. TWS	5 (89.3)	SCRAM	4.47 (89.3)	Common Cause	4.47 (89.3)		
		MFW	4.47 (89.3)	Unspec			
		HPI	2.32 (46.4)	Unspec			
		LPR	2.15 (42.9)	Unspec			

Table 4.5 Continued

Sequence	% CM Cont. (% Cut Sets Ex)	System Failures	Leading Cut Set Contributions % Total CMP	Seq. Related Dominant Failure Mode Contributors	% Total CMP	Sequence Related Component Failures	% Total CMP
8. TWS	3 (71)	LPSW	2.13 (71)	Common Cause	2.13 (96)		
		HPI	2.13 (71)	Dependent	2.13 (71)		
		SRV	0.55 (18.2)	Dependent	0.55 (18.2)		
		EFW	0.37 (12.4)	Unspecified	0.37 (12.4)		
		MFW	0.12 (4)	Unspecified	0.13 (4)		
9. TWS	3 (78.6)	SCRAM	2.36 (78.6)	Common Cause	2.36 (78.6)		
		LPR	2.36 (78.6)	Dependent	2.36 (78.6)		
		EFW	0.68 (22.6)	Unspecified	0.68 (22.6)		
		MFW	0.30 (10)	Unspecified	0.30 (10)		
		SRV	0.56 (18.6)	Unspecified	0.56 (18.6)		
10. T_2BU	2 (77.3)	HPI	1.55 (77.3)	Human	1.55 (77.3)		
		EFW	1.55 (77.3)	Random	1.55 (77.3)	UST	1.28 (64.2)
						TD Pump	0.15 (7.5)
						MOV	0.11 (5.4)
						AOV/SOV	0.1 (5)
		LPSW	0.062 (3.1)	Human	0.038 (1.9)		
				Random	0.024 (1.2)	Pumps	0.015 (0.73)
						MOV	0.01 (0.52)
11. VR	2 (100)	RPV	2 (100)	Random	2 (100)	Vessel	2 (100)

Note - Numbers in parentheses in column 2 represent the percent by weight of the total sequence cut sets examined (i.e. the leading cut sets). Numbers in parentheses in columns 4, 6 and 8 represent the percent by weight of the total sequence cut sets examined that involved the given item.

percent of the column 2 total CMP that was found by examination of the leading cut sets (28 x 97.53% = 27.31); it is important to note that the probabilities that these percentages represent are conditional, that is, dependent upon the initiating event and any preceding system failures (the numbers in parentheses are again percent of cut sets). The fifth column provides the failure mode contributions to each of the system failures. Four such modes were dominant in the PRA: common cause, dependent, random, and human error. As used herein, dependent failures refer to failures related to the initiating event or in some instances to preceding system failures.

The sixth column gives the contribution in percent to the total CMP and in parenthesis the percent of the column 2 total CMP that was found by examination of the cut sets. For example, in Sequence 1, 93.5% of the failure contribution of the low-pressure service water system is from random failure and 4.1% from dependent failures. Note that in many cases (including this example) the column six failure mode contributions do not total to 100% of the column 4 numbers in parentheses. This is because only those modes identified as leading contributors were considered.

The seventh column identifies the components associated with the relevant failure modes. For the dependent and human error modes, no components are identified since for these modes individual component failures are not associated with the system failure. The eighth column provides the individual component contribution to system failure for each failure mode. For example, in Sequence 1, 58.4% of the low pressure service water system contribution to the overall sequence CMP is due to failures of motor operated valves and this yields an overall 16.35 percent contribution to the CMP (28 x 58.4% = 16.35).

From information provided in Table 4.5, Table 4.6 was constructed in order to consolidate the contributions to internal CMP from systems, failure modes, and components. In Table 4.6, each system is considered separately, as indicated in the first column. The second column lists the number of sequences (identified in Table 4.5) in which the system appears as a contributor, and the third column gives the summation of percent contribution to CMP for each system.

The remaining five major columns give the failure mode contributions, including an "unspecified" column which provides quantification of the residual failure mode contribution not easily determined in the cut sets. For the "random" column, the component failure contributions to the respective failure modes are identified. The numerical entries for these columns were obtained directly from Table 4.5 and represent the direct percent of the internal CMP of each failure mode and component failure.

An example will aid in interpreting Table 4.6. The high-pressure injection system (HPI) appears as a system failure element in six of the CMP leading sequences. The total contribution of these six sequences to the CMP verified by cut set examination, is 50.99%. In other words, if the HPI failure probability could be reduced to 0 under the conditions of the six accident sequences, the total CMP calculated by the PRA for internal events would be reduced by at least 50.99%. The HPI failure contribution to CMP consists of 19.23% human, 29.44% dependent, and 2.32% unspecified.

Table 4.6 Total System and Component Failure Contributions to CMP from Leading Sequences

System	∑ Seq	% CMP Contribution	Random							Human	Dependent	Common Cause	Unspecified
			% CMP	MOV	Pump	UST	AOV/SOV	RX Vessel	Unspec				
LPSW	2	27.37	26.194	16.36	3.13				6.7	0.038	1.12		
HPI	6	50.99								19.23	29.44		2.32
SSF	1	27.31								27.31			
HPR	1	8.937	0.61	0.61						8.26			
MFW	5	22.57									17.68		4.89
EFW	5	20.28	4.18	0.11	0.15	3.91	0.1				15.06		1.05
LPR	4	19.19	0.07	0.07						13.91	3.06		2.15
SCRAM	3	8.96										8.96	
RPV	1	2	2					2					
Totals			33.05	17.15	3.28	3.91	0.1	2	6.7	68.75	66.36	8.96	10.41

Tables 4.7, 4.8, and 4.9 consolidate and summarize the results of Table 4.6 for failure mode, system failure, and component failure contributions to CMP. Table 4.8 lists all systems which appear in the eleven leading CMP sequences and the contribution each system imposes on the total CMP for internal event initiated sequences. Reducing the failure probability to 0 for each system would produce the corresponding reduction in CMP. It should be noted that improving the reliability of combinations of systems would not necessarily produce a benefit equivalent to the summation of the corresponding CMP contributions because more than one system appears in all sequences. The net effect of reliability improvements for combinations of systems would have to be determined by a close examination of Table 4.5. A similar statement can be made for combinations of components.

From the data in Tables 4.7, 4.8, and 4.9 the following insights are evident:

- Human and dependent failure modes appear to dominate failures of the systems important to CMP.
- HPI appears in over half of the total CMP contribution. Its major contributing failure mode arises from its dependence on service water for cooling and its second leading failure mode derives from human error mostly associated with failure to initiate in time in scenarios such that auto initiation would not be counted upon.
- Failure of the Safe Shutdown Facility (SSF) appears in over one quarter of the total CMP and is totally associated with operator failure to initiate in time.
- Random component failures do not play a significant role in the top 80% of the CMP. The failure of MOVs dominates this category and most of this comes from the failure of valve 108 in the service water system, which initiates a transient and terminates service water cooling.

4.3 External Events

This section presents a summary of the results of the external events analysis from the Oconee 3 PRA.

The PRA considered a total of five external event initiators. These are listed in Table 4.10, with indications of the percent contribution to external CMP. Even after plant modifications, turbine building flooding is still the dominant initiator.

According to the PRA, the total core melt probability from external events is 2.0E-4/yr. Thus, external events contribute 78.7% to the total CMP. The significance of external events to early and late fatality risks is discussed in Section 4.4.

The PRA explicitly provides the leading cut sets for the external events contribution to CMP. The cut sets are categorized by plant damage bin. Table 4.11 is the compilation from examining 86.1% (by weight) of the cut sets for external CMP. The first column lists the initiator category, and the second provides its overall numerical contribution to CMP, from Table 4.10. Column

Table 4.7 Failure Mode Contribution to CMP from Leading Sequence/Cut Sets (Oconee)

Failure Mode	% Contribution
Random	33.05
Human	68.75
Dependent	66.36
Common Cause	8.96
Unspecified	29.29*

*81.12% (by weight) of the cut sets for the total CMP were investigated leaving 18.88% not investigated and 10.41% from Table 4.6.

Table 4.8 System Contribution to CMP from Leading Sequence/Cut Sets (Oconee)

System	% CMP*
HPI	50.99
LPSW	27.37
SSF	27.31
MFW	22.57
EFW	20.28
LPR	19.19
SCRAM	8.96
HPR	8.94
RPV	2.0

*Based upon investigation of 81.12% (by weight) of total CMP cut sets.

Table 4.9 Component Failure Contribution to CMP from Leading Sequence/ Cut Sets

Component	% CMP*
MOV	17.15
UST	3.91
Pump	3.28
RPV	2.0
AOV/SOV	0.1

*Based upon investigation of 81.12% (by weight) of total CMP cut sets.

Table 4.10 Mean Annual Core Melt Frequencies for External Initiating Events[a]

		% CMP
Turbine-building flood[a]	8.8-5	44.2
Earthquake[b]	6.3-5	31.7
External flood[b]	2.5-5	12.6
Tornado[b]	1.3-5	6.5
Fire[b]	1.0-5	5.0
Total	2.0-4	100.00

[a]Based on analysis of the modified plant.
[b]Based on analysis of the unmodified plant.

Table 4.11 External Events - Oconee

INITIATOR CATEGORY	EXTERNAL CMP	PLANT DAMAGE BIN	EXT. CMP	SEQ. #	% EXT. CMP	TRANSIENT RESPONSE	DEPENDENT FAILURE	RANDOM	% EX CMP	HUMAN	% EX CMP
SEISMIC	6.3E-5	I	1.1E-5	1	0.4 (7E-7)	Aux. bldg. masonary walls	MFW EFW HPI	SRV FTC	0.4		
				2	0.9 (1.8E-6)	Condenser Hotwell CCW piping	MFW EFW HPI	SRV FTC	0.9		
				3	0.2 (4E-7)	Letdown piping AC power	LPI HPI				
				4	0.2 (4E-7)	Letdown piping Aux. bldg. masonary walls	LPI HPI				
				5	0.1 (2E-7)	Feedwater Heaters Upper storage tank AC power	MFW EFW HPI	SRV FTC	0.1		
				6	0.2 (3E-7)	AC power EFW TDP cooling	MFW EFW	SRV FTC	0.2		
		II	2.6E-6	1	1.3 (2.6E-6)	Jocassee Dam	SSF				
		III	4.6E-5	1	5.0 (1E-5)	AC power	HPI				
				2	7.5 (1.5E-5)	Aux. bldg. walls	HPI MFW AFW				
				3	5.0 (1E-5)	Condenser	MFW EFW				
				4	0.5 (1E-6	SSF power/3 (1.67%) Feedwater Heater UST AC power	MFW EFW HPI	SSF/3 SSF/2	1.67 0.25	SSF/3 SSF/2	1.67 0.25

BEST COPY AVAILABLE

Table 4.11 Continued

INITIATOR CATEGORY	EXTERNAL CMP	PLANT DAMAGE BIN	EXT. CMP	SEQ. #	% EXT. CMP	TRANSIENT RESPONSE	DEPENDENT FAILURE	RANDOM	% EX CMP	HUMAN	% EX CMP
		V	3.2E-6	1	0.8 (1.5E-6)	RCS piping AC power	LPI				
				2	0.8 (1.5E-6)	RCS piping Aux. bldg. wall	LPI				
		VI	1.6E-8	1	ε (1.6E-8)	RCS piping Jocassee Dam	LPR				
TORNADO	1.3E-3	I	2.2E-6	1	1.1 (2.2E-6)	LOOP Rx TRIP MFW	EFW HPI BWST	SRV FTC	1.1		
		III	1E-5	1	5.0 (1E-5)	LOOP Rx TRIP MFW	EFW ASW feedwater				
				2	0.3 (6.5E-7)	LOOP Rx TRIP MFW	HPI				
				3	0.3 (5E-7)	LOOP Rx TRIP MFW	EFW HPI				
FIRE	1.01E-5	I	6.5E-6	1	0.6 (1.2E-6)	Cable shaft fire Rx TRIP	Small LOCA (PORV) HPI				
				2	2.7 (5.3E-6)	Cable shaft fire Rx TRIP	Seal LOCA HPI				
		III	3.6E-6	1	1.8 (3.6E-6)	Cable shaft fire Rx TRIP	HPI/2 (0.9%) EFW/2 (0.9%)				

BEST COPY AVAILABLE

Table 4.11 Continued

INITIATOR CATEGORY	EXTERNAL CMP	PLANT DAMAGE BIN	EXT. CMP	SEQ. #	% EXT. CMP	TRANSIENT RESPONSE	DEPENDENT FAILURE	RANDOM	% EX CMP	HUMAN	% EX CMP
EXTERNAL FLOODS	2.5E-5				12.5 (2.5E-5)	Jocassee Dam	MFW EFW HPI LPI SSF				
INTERNAL FLOODS (TURBINE BLDG.)	8.8E-5	I	3.2E-5	1	7.5 (1.5E-5)	FLVN then Aux. bldg. flood	MFW EFW HPI	SRV FTC	7.5		
				2	1.2 (2.4E-6)	FVLI then Aux. bldg. flood	MFW EFW HPI	CCW VALVES(3/4)	0.9	CCW No Isol/4	0.3
				3	0.2 (3.9E-7)	FLN	MFW EFW LPSW HPI	SRV FTC	0.2		
				4	4.6 (9.1E-5)	FVLN	MFW EFW HPI	SSF(1/3)	1.5	SSF(2/3)	3.1
				5	0.7 (1.4E-6)	FVLI	MFW EFW HPI	CCW VALVES SSF(1/3)	0.2	SSF(2/3)	0.5
				6	0.2 (3.8E-7)	FVLI	RCP SEALS HPI			CCW	0.2
				7	0.6 (1.1E-6)	FLN	EFW LPSW HPSW HPI	SSF(1/3)	0.2	SSF(2/3)	0.4
		III	3.7E-5	1	3.0 (1.6E-5)	FVLN	MFW EFW HPI	SSF MOV	8.0		

BEST COPY AVAILABLE

Table 4.11 Continued

INITIATOR CATEGORY	EXTERNAL CMP	PLANT DAMAGE BIN	EXT. CMP	SEQ. #	% EXT. CMP	TRANSIENT RESPONSE	DEPENDENT FAILURE	RANDOM	% EX CMP	HUMAN	% EX CMP
				2	1.3 (2.5E-6)	FVLI	MFW EFW HPI EFW	CCW VALVES SSF MOV	1.3 1.3		
				3	0.9 (1.7E-6)	FMN				HPI	0.9
				4	3.4 (6.7E-6)	FLN	EFW MFW LPSW	SSF(1/3)	1.1	SSF SSF(2/3)	0.9 2.2
				5	1.4 (2.8E-6)	FLII/FLIO	MFW EFW LPSW	CCW VALVES SSF(1/3)	0.5	SSF(2/3)	0.9
				6	0.9 (1.7E-6)	FMII	LPSW HPR	SSF(1/3)	0.3	SSF(2/3)	0.6
		IV	1.7E-5	1	3.2 (6.3E-6)	FLN	EFW MFW LPSW	SSF	3.2		
				2	1.4 (2.7E-6)	FLII/FLIO	MFW EFW LPSW	CCW VALVES SSF	1.4 1.4		
				3	3.4 (6.8E-6)	FMN	MFW EFW HPR	LPSW pump SSF pump	3.4 3.4		

TOTAL % EXTERNAL CMP EXAMINED --→ 86.1%

Note: The following lists the turbine-building flood initiating events.
F_{VLI}--Very large (300,000 gpm) flood, isolable.
F_{VLN}--Very large flood, nonisolable.
F_{LII}--Large (75,000 gpm) flood on the inlet side of the condenser, isolable.
F_{LIO}--Large flood on the outlet side, isolable.
F_{LN}--Large flood, nonisolable.
F_{MII}--Medium (30,000 gpm) flood on the outlet side, isolable.
F_{MIO}--Medium flood on the outlet side, isolable.
F_{MN}--Medium flood, nonisolable.

BEST COPY AVAILABLE

three lists the plant damage bin, and column four provides that bin's numerical contribution to CMP. Columns five and six simply order the sequences within each bin and provide the percent and (numerical) contribution to CMP of each sequence. The seventh column provides the initial transient response of the plant (i.e., what broke). The eighth column lists all the dependent system failures based upon the initiating event and plant response, and the final four columns track those additional random or human errors that also occurred. Because each sequence entry has multiple cut sets provided for review, some table entries have fractions next to them denoting in what fraction of the total sequence they played a part. All percentages represent % of total external CMP.

Review of Table 4.11 provided the following insights with respect to external events:

- External events comprise 78.7% of the total CMP.
- Major dependent system failures were found in all 86.1% of the cut sets examined, and 100% of the external CMP cut sets are expected to display this phenomenon.
- The external events of the study were severe enough that in well over 50% of the sequences additional failures were not needed for core melt.
- Random failures were included in 34.32% of the cut sets. This category was dominated by failures in the SSF (23%) and primary system SRVs failing to close following actuation (10.4%).
- Human error accounted for only 11.22% of the external CMP, but this category was totally dominated by human errors associated with the SSF (10.52%).
- In the seismic sequences, the auxiliary building masonary walls are capable of failing MFW, EFW, and HPI if they crumble.
- All of the tornado sequences were similar in that they all started with LOOP, RX trip, and trip of MFW.
- Only one fire area was analyzed in the PRA. This was the cable shaft area, in which a fire can result in failure of any or all of the following:

  a. main feedwater controls,
  b. emergency feedwater controls,
  c. HPI controls,
  d. LPI controls,
  e. fan cooler power and controls,
  f. RB spray controls,
  g. PORV and block valve controls.

- Cut sets were not provided for the external flood initiator which was taken to be failure of the Jocassee Dam. Dam failure is capable of

flooding the turbine and SSF buildings, thus failing MFW, EFW, HPI, LPI, and SSF functions.

- In spite of the modifications to the turbine building to improve the plant response to turbine building flooding, this initiator is still the overall largest contributor to CMP.

4.4 Risk

The PRA presents curves of exceedance frequency vs number of fatalities for both early and latent cancer fatalities. Figure 4.1 shows the latent and early fatality curves for internal initiating events, and Figure 4.2 shows similar curves for external initiating events. The PRA did not explicitly define leading cut sets for the risk aspects of the study as it did for CMP.

Six major release categories were defined for Oconee, with the general characteristics given in Table 4.12. The consequence ranges for these six categories are summarized in Table 4.13. Categories 3 and 5 were found to have no meaningful contribution to health effects. The mean frequency per year and its relation to the overall CMP are also given, as are the split between internal and external events for each release category. The following insights on risk are derived from the foregoing:

- 35.25% of the CMP does not enter into any risk category.
- An additional 63% of the CMP represents low to intermediate consequence portions of the CCDFs.
- The highest risk category represents 0.01% of the total CMP.
- The overall split in CMP between internal and external events is approximately 20% to 80%. In all but one release category, external events exhibit a larger than 80% contribution. The PRA notes that the Reactor Building Sprays are relatively more likely to fail under external events than internal. The discrepancy in release category 2 (i.e., internal >30%) is based on the inclusion of the sequences that include steam generator tube rupture with a stuck open SRV on the same generator, which yields a direct path to the environs.

REFERENCES

1. NSAC 60, "A Probabilistic Risk Assessment of Oconee Unit 3," June 1984.
2. Probabilistic Risk Assessment (PRA): Status Report and Guidance for Regulation Application, NUREG-1050, USNRC, February 1984.

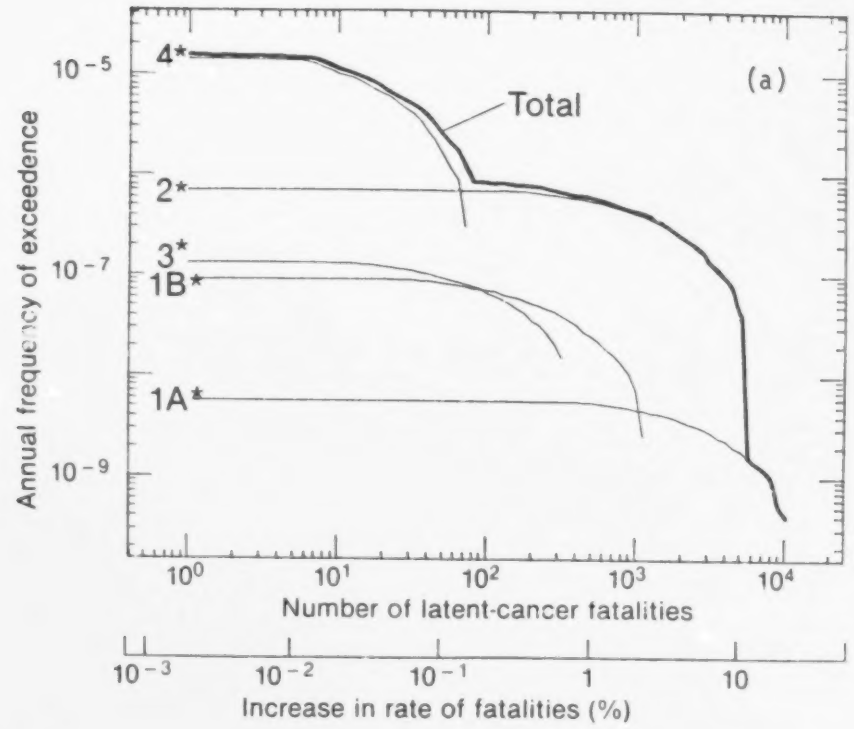

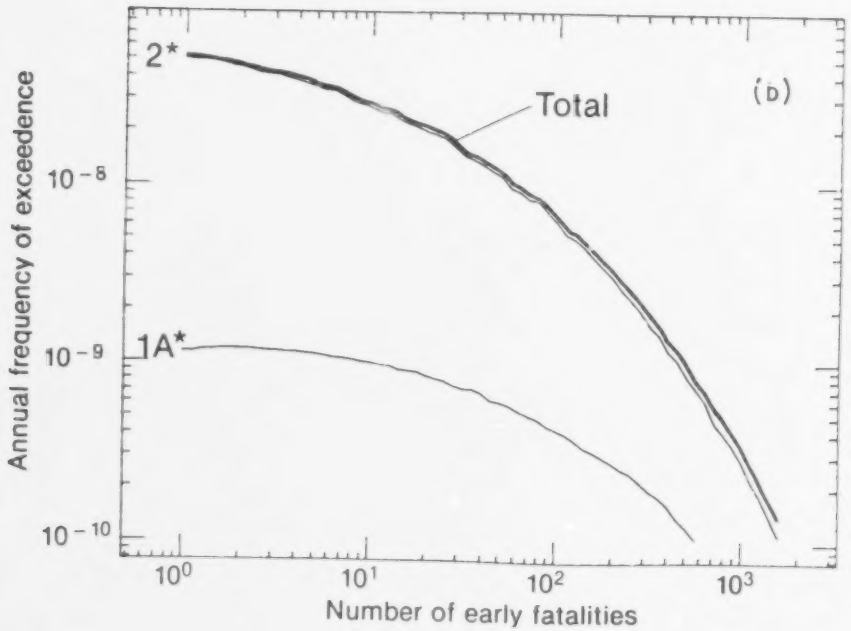

Figure 4.1 Oconee Unit 3 risk curves for all internal initiating events: (a) latent-cancer fatalities and (b) early fatalities. *Release categories as defined in Table 4.12.

BEST COPY AVAILABLE

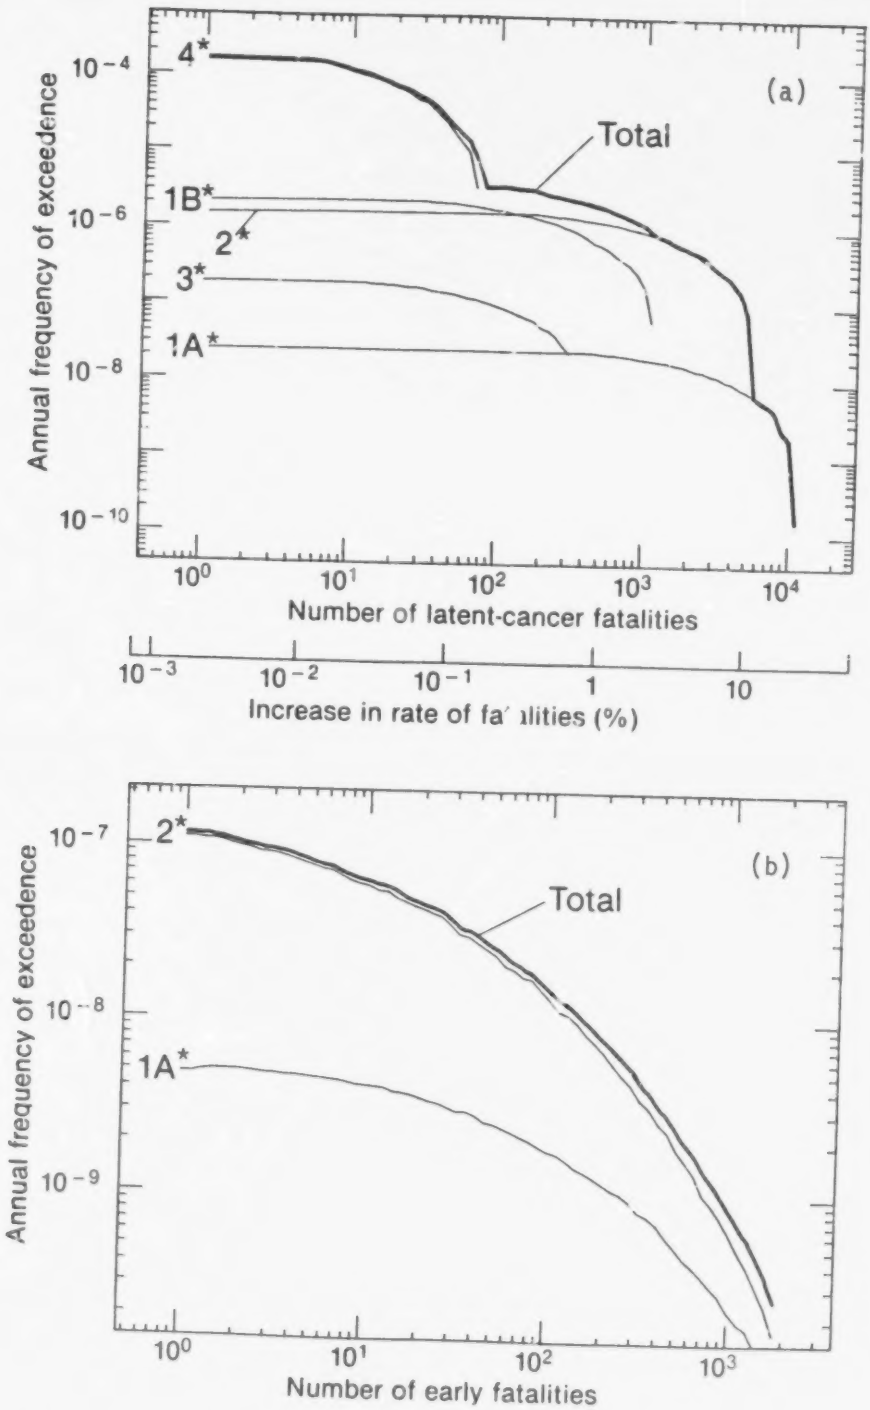

Figure 4.2 Oconee Unit 3 risk curves for external initiating events (modified plant): (a) latent-cancer fatalities and (b) early fatalities.
*Release categories as defined in Table 4.12.

BEST COPY AVAILABLE

Table 4.12 Summary of Oconee Release Categories

Release Category	Time of Release (Hr)	Duration of Release (Hr)	Warning Time for Evac. (Hr)	Elevation of Release (Meters)	Containment Energy Release (10^6Btu/Hr)
1A					289.0
Puff 1	2.5	0.5	1.5	21.5	77.0
Puff 2	3.0	2.5	2.0	21.5	
1B	24.0	0.5	20.0	21.5	289.0
2	1.5	3.5	0.5	0	33.0
3	1.5	1.5	0.5	0	33.0
4	62.0	0.5	60.0	21.5	289.0
5	1.5	3.0	0.5	0	0.08

101

Table 4.13 Summary of Consequence Ranges for Which Release Categories Affect Risk Curves

Release Category	Latent Cancer Fatalities	Early Fatalities	Mean Frequency (Yr^{-1})	% Overall Total CMP	% Contribution External Events	% Contribution Internal Events	Comments
1A	6000-11000	1000-7000	2.9E-8	.01	85.55	14.45	RC1A ranges represent the highest-consequence portions of the CCDFs.
1B	100-1000	No effect	2.2E-6	.87	93.41	6.59	RC1B ranges represent a narrow segment of the intermediate-consequence of the CCDFs
2	100-6000	1-2000	2.2E-6	.87	68.32	31.68	RC2 ranges represent intermediate- to high-consequence portions of all CCDFs and low- to high-consequence portions for early fatalities
3	No effect	No effect	-	-	-	-	
4	1-100	No effect	1.6E-4	63	92.49	7.51	RC4 ranges represent the low- to intermediate-consequence portions of the CCDFs
5	No effect	No effect	-	-	-	-	

BEST COPY AVAILABLE

5. DISCUSSION AND RANKING OF THE VARIOUS ELEMENTS OF THE METHODOLOGIES

5.1 Introduction

The four subject PRAs have been analyzed in accordance with the guidelines of NUREG/CR-3852, "Insights into PRA Methodologies." Section 5.2 provides a brief description of how each of the PRAs handled the various aspects involved in performing a PRA as outlined in the NUREG report. Section 5.3 includes a table in which the areas discussed above are ranked against one another (PRA to PRA) by using the levels of effort developed in the NUREG report, which are defined in Section 5.2 for each area. Note that the ranking process prescribed in the NUREG report did not in all cases result in a ranking category that truly matched what was actually done in the PRA effort. Therefore, the ranking required a certain amount of judgment, which introduced some uncertainty into the results.

5.2 Discussion of the Elements of the Methodologies

The following items correspond to the 20 categories listed in NUREG/CR-3852, with some rearrangement in the order of presentation, as well as some additional items added for the current evaluation because the NUREG report did not address external events.

5.2.1 Identification of Initiating Events

Description	Levels of Effort
Identify transients and LOCA initiating events	A. Use WASH-1400 (16) B. WASH-1400 plus EPRI NP-801 C. Generic events plus plant specific (17)

a. Millstone

Extensive review of plant operating data plus plant specific assessment. Used three LOCAs plus special LOCAs (interfacing system and R.V.), SGTR, SL break inside and out of containment and 14 transients.

b. Seabrook

Used Master Logic Diagram (similar to fault tree with top event being release of radioactive materials) which branches downward into initiating events. Also used Plant Heat (energy) Balance Fault Tree to provide more detail, then used historical initiating events, other PRAs, feedback from risk model, FMEA.

c. Shoreham

The PRA utilized WASH-1400, other PRAs, LERs, and plant specific items to generate the set of initiating events.

d. Oconee

The PRA used available sources as well as plant specific analyses for determining the initiating events.

5.2.2 Estimation of Frequency of Initiating Events

Description	Levels of Effort
Work performed to estimate the frequencies of initiating events	A. Generic data B. Generic data and plant specific C. Two-stage Bayesian

a. Millstone

Based on domestic PWR experience plus site specific LOOP estimate. For relatively frequent events, classical statistical methods used, for rare events, Bayesian approach.

b. Seabrook

Used data from other power plant experience for events applicable to Seabrook. For plant specific initiators (interfacing systems LOCA, loss of S.W.S., and CCW loss) did a plant specific analysis. Used EPRI-2230 as primary source for events which have already occurred. Data were modified, other sources used, and frequency computation performed (proprietary). For LOCA and steam breaks, used Nuclear Power Experience and other data. Frequency determination for these events also proprietary.

c. Shoreham

The PRA used the following sources in the order of their priority for quantifying the frequencies of initiating events: a) plant specific, b) NRC data, c) General Electric Co., d) WASH-1400, and e) IEEE 500.

d. Oconee

The PRA used generic data and used a one-stage Bayesian update of the generic date for plant specific data, where available.

5.2.3 Event Tree Modeling Technique

Description	Levels of Effort
Options for accident sequence modeling using event trees	A. Small systemic event trees for each initiating event class B. Large event trees for each plant state

a. Millstone

Approach is consistent with PRA Procedures Guide (NUREG-2300). Used plant functional event tree model. Used support state concept to account for support system failures. Functional event trees used, and six top events defined with a total of 44 systems used (some duplications) for the top events. Very comprehensive event trees. For example, 55 different sequences are defined for the loss of off-site power initiators for a particular support state.

b. Seabrook

Used event sequence diagrams which are used to construct event trees. Twelve event sequence models used to cover all initiating events. Very comprehensive event trees. For example, the generalized transient event tree has 159 possible sequences.

c. Shoreham

The PRA developed and quantified separate event trees for those initiating events which may have a strong effect on the system available for accident mitigation and plant cooldown.

d. Oconee

The PRA employed the systemic event tree approach.

5.2.4 Aggregation of Initiating Events

Description	Levels of Effort
The extent to which initiating events are combined as entry points for event trees	A. Complete aggregation; one initiating event category for all accidents C. Aggregation based on function or phenomena E. Little or no aggregation

a. Millstone

Very little aggregation employed. Used 17 event trees to represent all 21 internal event initiating events considered.

b. Seabrook

Some aggregation done for similar initiating events. A total of 58 initiating events (24 internal, 34 external) were grouped into 12 event trees.

c. Shoreham

The PRA did do some aggregation based upon function or phenomena.

d. Oconee

Some aggregation was performed.

5.2.5 Hardwired System Dependency Analysis

Description	Levels of Effort
Identification and quantification of impact of hardwired system dependencies	A. Engineering judgment based on prior knowledge and insights C. Systematic hand analysis based on system diagrams E. Large-scale Boolean reduction code

105

a. Millstone

Used support state method in which each support system interaction with front-line systems was defined and analyzed deterministically. Five support systems were identified, and eight support states were used with different combinations of support system availabilities. These eight support states were obtained by combining the initial 72 support states into groups with similar plant states. A computerized support state model was employed to analyze the support state dependencies.

b. Seabrook

Two support sytem matrices were developed to relate support system interdependencies, as well as support system dependencies, with front-line system dependencies. A total of 10 support systems were defined, and their dependency with 11 front-line systems/functions was assessed. Boundary conditions were defined which corresponded to various combinations of support system failures. System unavailabilities were then quantified for appropriate boundary conditions.

c. Shoreham

Ac power, dc power, and service water were explicitly modeled in the event trees. The remaining support systems were modeled in the fault trees. For the three above, an event tree was used to screen the quantitative contribution of these dependences out of the systemic event trees. Once calculated, these contributions were then transferred to the applicable initiator for special processing through an event tree logic diagram suited to represent the predetermined conditions of the support system.

d. Oconee

The major support systems were developed in fault trees and combined with the appropriate frontline systems using SETS to solve the sequences.

5.2.6 System Interaction Analysis

Description	Levels of Effort
System interactions other than hardwired	A. No analysis to identify interactions C. Engineering insights D. Plant walk-through E. Plant walk-through coupled with detailed analysis of failure modes and effects

a. Millstone

In general, intersystem physical interactions modeled only for external common cause initiators. For internal events, physical interaction dependencies are embodied in success criteria and damage limits for components. Some were modeled in conjunction with intersystem functional dependencies. Intersystem physical interactions were modeled on an event and sequence specific basis.

106

b. Seabrook

Spatial interactions were considered for external initiating events. Drawings and other plant studies were used, as well as plant walk-throughs, to establish spatial interactions which could be important. The SETS computer code is used to quantify and identify the important spatial interactions.

c. Shoreham

Engineering insights and plant walkdowns were used as inputs to the plant modeling. In one specific case, a common cause analysis was also performed and related to flooding at elevation 8 of the reactor building.

d. Oconee

The PRA includes the results of plant walkdowns and detailed analyses of potential threats and attendant vulnerabilities.

5.2.7 Treatment of the Post-Accident Heat Removal Phase

Description	Levels of Effort
Consideration of accident duration and equipment recoverability assumptions	A. 24-hr duration with no recovery of mechanical failures B. Realistic accident durations without recovery of mechanical failures C. Realistic accident durations with recovery of mechanical failures

a. Millstone

For purposes of system unavailability analysis, a 24-hour mission time was generally assumed. However, for accident recovery analyses, realistic accident times were estimated, and recovery of systems with assumed mechanical failures was considered.

b. Seabrook

For purposes of system unavailability analysis, a 24-hour mission time was generally assumed with plant conditions stable and expectation of continued cooling. The possibility of manual recovery of mechanical failures was assumed in selected cases including the turbine driven auxiliary feedwater, the service water system, and the electric power system. In these cases, realistic estimates of accident times were made.

c. Shoreham

Operator actions which are required by procedures or which are possible to remedy a failed system are depicted and evaluated. Realistic accident time intervals were used for the mission times.

d. Oconee

Realistic accident time intervals were used, and the leading cut sets were examined individually to determine what recovery measures could be taken.

5.2.8 Evaluation of Human Errors During Normal Operation

Description	Levels of Effort
Quantification of the effect of human errors during plant operation (miscalculation, unsafe valve alignment, etc.)	A. Conservative scoping human error values C. Human error estimates (i.e., NUREG-1278) with a non-detailed analysis E. Human error estimates using detailed methodology (i.e., THERP tree analysis)

a. Millstone

Conservative screening values were used throughout the study based on data from NUREG-1278. Since operating procedures were not developed for Millstone 3 at the time of the PRA, procedures from Units 1 and 2 were used. The THERP analysis was used to determine human error contribution to component unavailability.

b. Seabrook

Human errors are accounted for in assessing system reliability. Contributions from outage due to maintenance (planned and unplanned) or tests as well as human errors in testing and maintenance are considered. The principal source of human error rate used was NUREG-1278.

c. Shoreham

The PRA used NUREG/CR-1278 as the source for maintenance and operations errors and further includes items such as stress and response times.

d. Oconee

The PRA evaluates the human errors by a detailed analysis which accounts for ambiguity, stress, time available, etc.

5.2.9 Evaluation of Human Errors During an Accident

Description	Levels of Effort
Quantification of human errors which could occur during an accident sequence	A. Conservative scoping human error values C. Human error estimates (i.e., NUREG-1278) with a non-detailed analysis E. Human error estimates using detailed methodology (i.e., THERP tree analysis)

a. Millstone

Both cognitive (decision making) and procedural errors are considered. The time available for action is evaluated, in addition to the diagnostic information available to the operator based on the accident scenario. The complexity of the required action is also taken into account. Recovery of

108

failed systems was considered in selected cases. The methodology employed was generally the cognitive error model in the NREP Procedures Guide. Human error rates from NUREG-1278 were generally used. The THERP analysis was used to determine human error contribution to component unavailability via restoration errors.

b. Seabrook

Operator action trees were employed in evaluating human error contributions during accidents. The plant simulator was used to assist in defining potential operator errors by inputting accident scenarios and evaluating operator plant status perception matrix. Error rates were established by the PRA study team.

c. Shoreham

The PRA does not consider errors of commission by the operator. The error model in the NREP Procedures Guide was used with data from NUREG/CR-1278.

d. Oconee

The PRA utilizes the same very detailed methodology as discussed for normal operation above in evaluating postaccident human errors.

5.2.10 Common Mode Analysis

Description	Levels of Effort
Level of effort applied to common mode human error analysis	A. No common made human error analysis B. Selective analysis of common mode human error analysis D. More potential common mode failures and more consistent evaluation than B

a. Millstone

Multiple common cause human errors of design, test/maintenance, and incorrect calibration and operation were considered. The binomial failure rate model was employed, based on actual operating plant statistics corrected as necessary to reflect specific features of Millstone 3.

b. Seabrook

Common cause human errors were considered and quantified by use of the beta-factor model, and also by the dependence model provided in NUREG-1278. Judgment was applied to determine the degree of dependence between human errors.

c. Shoreham

The PRA utilized this methodology in evaluating the miscalibration of four level sensors. It also modeled coupling between operators.

d. Oconee

The PRA included common cause human error analysis in a number of instances and included within this the coupling between operators when more than one would/could be involved in the particular scenario.

5.2.11 Treatment of Recovery

Description	Levels of Effort
Possible operator recovery actions	A. No recovery B. Recovery from human errors and automatic actuation systems failures D. Recovery from human error, actuation system failure, and individual components

a. Millstone

Analyses were performed to determine time intervals and flow rate requirements for recovery of risk dominant sequences. System recovery actions, use of alternative systems, and recovery of failed components were considered and quantified.

b. Seabrook

Recovery was considered for risk significant accident sequences where operator action was considered to be feasible. Recovery of failed automatic systems (i.e., turbine driven auxiliary feedwater) was considered, as was recovery of failed support systems (i.e., service water, control room H&V, containment enclosure air cooling system). Extensive analysis of recovery from loss of AC power was performed, including recovery of failed diesel generators.

c. Shoreham

Operator recovery actions were included for human errors, failure of automatic actuation systems, and selected components.

d. Oconee

All leading cut sets were examined to determine what recovery actions were possible and what the appropriate probabilities should be.

5.2.12 Modeling of AC Power Systems

Description	Levels of Effort
Level of detail in modeling and quantifying AC power support system	A. Past PRA models of AC power systems C. Simple, non-detailed models E. Detailed fault trees with support system interfaces

a. Millstone

AC power (main electrical system) modeling was detailed, extensive, and plant specific. Diesel generator failure rates were based on tests of Millstone 3 diesel generators and similar units. Support system interfaces and dependencies were assessed in detail.

b. Seabrook

AC power (electric power system) modeling was detailed, extensive, and plant specific. Support system interfaces and dependencies were assessed in detail.

c. Shoreham

The power system was divided into three areas: offsite, onsite AC, and DC, and each was modeled in plant-specific detail.

d. Oconee

The Oconee power system is quite unique and all aspects were modeled in specific detail.

5.2.13 Modeling of Logic (Actuation) Systems

Description	Levels of Effort
Level of detail in modeling and quantifying logic equation systems	A. Using past PRA models of logic systems (unreliability of $\sim 10^{-3}$/train) C. Simple models E. Detailed fault tree models

a. Millstone

The engineered safety features actuation system is the actuation system for the Millstone 3 plant. It was modeled with detailed fault trees based on plant specific design as well as test and maintenance procedures and schedules which are to be implemented at the plant.

b. Seabrook

The actuation systems for Seabrook consist of the reactor trip, engineered safety features actuation, and solid state logic protection systems. These systems were analyzed together, utilizing detailed fault trees based on plant specific design and test and maintenance procedures and schedules planned for the plant.

c. Shoreham

Logic systems were modeled in plant-specific detail.

D. Oconee

Logic systems were modeled in plant-specific detail.

5.2.14 Common Cause

Description	Levels of Effort
Level of effort expended to perform hardware common cause analyses	A. No common cause analysis B. Analysis on a few components identified by engineering judgment C. Consistent analysis using nuclear experience data

a. Millstone

The common cause analysis consisted of a detailed assessment, consistently applied, using operating nuclear plant data. The binomial failure rate model was employed for common cause system and hardware analysis.

b. Seabrook

Common cause failures were consistently treated either explicitly by identifying causes of common cause failure and incorporating them explicitly in the systems, or implicitly by using certain parameters to account for their contribution to system failure. The basic parametric model used to quantify common cause failures was the beta factor method. Some beta factors were quantified with design specific nuclear plant data screened for applicability to Seabrook. Where data were sparse or nonexistent, a generic beta factor was used.

c. Shoreham

Common cause analysis was included in the modeling of the reactor building flood at elevation 8.

d. Oconee

Some common cause analysis was included in the PRA and was directed by engineering judgment.

5.2.15 Component Reliability Data Base

Description	Levels of Effort
Type of data base used in PRA	A. Generic data only (e.g., WASH-1400 or IREP data base) C. Generic data augmented by plant specific for a few important fault types E. Generic and plant specific employing Bayesian treatment

a. Millstone

The data were generated primarily from the Westinghouse Data Base, which is proprietary. These data are based extensively on Westinghous nuclear plant operating experience, which covers a time span of 1972 through 1981 and contains over 200 reactor-years of plant operation. For cases with little or no nuclear data for the hardware, ten other data sources were used.

b. Seabrook

Component failure rate distributions were developed based on information from a variety of generic data sources as well as detailed plant specific data collected in the process of performing PRAs on several other plants. Details regarding the generation of each specific failure rate are proprietary. A Bayesian updating procedure was used to integrate data from several sources into uncertainty distributions for failure rates. Operating experience data were used, and screening of LERs was performed for particularly risk sensitive components.

c. Shoreham

The data base utilized plant-specific data where possible; however, the plant had no operational data base.

d. Oconee

The PRA used generic data as a prior and then performed a one-stage Bayesian update based on available plant-specific data.

5.2.16 Use of Demand Failure Probabilities

Description	Levels of Effort
Treatment of demand failure probabilities from a generic data base for components with very long test intervals	A. Use of demand failure probability directly from generic data base C. Use of generic demand failure probabilities combined with long test period

a. Millstone

The probability of failure on demand was derived by obtaining the ratio of the total number of failures on demand (from various data sources) to the total number of challenges.

b. Seabrook

The method used for derivation of demand failure probabilities could not be found in the PRA. Proprietary documents are referenced as sources of information used to develop demand failure distributions.

c. Shoreham

Demand failure rates are converted to failure probabilities over the appropriate time interval.

d. Oconee

The probability of failure on demand was derived where possible from plant-specific data by taking the ratio of number of failures (from various plant records) to number of challenges over the plant's life.

5.2.17 Use of Means Versus Use of Medians

Description	Levels of Effort
Use of means or medians of data for component fault quantification	A. Use of either means or medians (No other levels considered)

a. Millstone

Mean values were used for component failure rates.

b. Seabrook

Mean values were used for component failure rates.

c. Shoreham

Mean values were used for component failure rates.

d. Oconee

Means were used as the point value estimates from the data distributions.

5.2.18 System Success Criteria

Description	Levels of Effort
Determination of system success criteria	A. Use system criteria in the Final Analysis Report C. Realistic, plant specific phenomenological analysis

a. Millstone

A majority of the success criteria were based on best-estimate plant specific safety analysis. However, certain success criteria rely on the safety analysis from the Millstone 3 FSAR.

b. Seabrook

No specific overall discussion of system success criteria was found in the PRA. However, the study generally used best estimate.

114

c. Shoreham

The PRA success criteria represent realistic requirements and were determined in part from vendor deterministic analyses.

d. Oconee

The PRA success criteria represent realistic requirements.

5.2.19 Treatment of Test and Maintenance Outages

Description	Levels of Effort
Modeling of test and maintenance outage contributions	A. Generic data for maintenance frequencies and test and maintenance outage times B. Generic data with repair times based on plant specific data D. Plant specific data for all test and maintenance parameters

a. Millstone

Test outages are based on test frequencies required in the Millstone Technical Specifications and the reported times to test. Operational data for Millstone Units 1 and 2 were used for the time to test pumps and valves, assuming that the test time is log normally distributed. Component unavailability due to maintenance outages was based on random failure rates and assumed repair times. The Millstone Unit 3 Technical Specification limit on downtime for any train was used as the upper bound repair time, and Millstone Units 1 and 2 experience was used to establish minimum repair time. Log normal distribution was assumed.

b. Seabrook

Test outages are based on technical specifications for Seabrook. Four maintenance frequency distributions were developed for four general component categories based on component type, service duty, and technical specification inoperability limitations. Log normal distributions were assumed. The distributions for the duration of maintenance were developed for the four general maintenance categories. The distributions were based primarily on the applied inoperability time limitations for each component category. Details of the development of the distributions are proprietary.

c. Shoreham

Plant specific data are not available for this plant, and essentially WASH-1400 input was used.

d. Oconee

The PRA combined generic data with plant-specific data wherever available to develop the test and maintenance data base.

5.2.20 Environmental Qualification

Description	Levels of Effort
Modeling of environmental qualification of equipment	A. Not considered B. Engineering judgment C. Calculation of environments, and failure assumed for severe environment exposure E. Calculation of environments, and modification of failure probabilities

a. Millstone

Environmental effects including grit, moisture/humidity, temperature, electromagnetic interference, radiation exposure, and vibration were analyzed on the basis of the binomial failure rate common cause model using data from operating reactors (corrected for application to Millstone 3). Further detail not provided.

b. Seabrook

Environmental effects are mentioned as failure contributors, but the methodology and data used for evaluating such effects could not be found in the SSPSA except for external events that create environmental stress. In these cases, a spatial interaction analysis was used.

c. Shoreham

Could not find subject addressed in the PRA.

d. Oconee

Engineering judgment was used to augment the evaluation as to whether certain components needed for a successful sequence could function in the expected environment carried by the sequence.

5.2.21 External Event Methodology

Description	Levels of Effort
Scope and treatment of external events	Not applicable (not considered in NUREG/CR-3852)

a. Millstone

Eight external events were considered: earthquakes, fires inside the plant, internal and external flooding, winds (and associated missiles), aircraft crashes, transportation and storage of hazardous materials, and turbine missiles. The events were initially screened for significance by examining their frequency and severity and the vulnerability of the plant to damage from them. The screening showed only earthquakes and fires to be significant

contributors. Briefly, the methodology used for these two contributors was as follows:

i. Earthquakes - The probability of earthquakes near the site was estimated. Seismic fault trees for various core damage states were developed, and seismic fragility analyses for various plant systems were perfomed. Probability distributions for fragilities were developed assuming a Weibull distribution. The base events of the seismic core melt fault tree were quantified, yielding a seismic core melt frequency and uncertainty. Seismic related containment event trees were prepared and quantified for seismic related containment failure modes. The consequence analyses were modified to account for slower evacuation speeds and alternative routes.

ii. Fires - Fire probabilities in certain plant areas were assessed on the basis of utility experience. Mechanistic models of fire propagations and the effects of mitigation were evaluated. Fire related operator actions and human errors were quantified. Overall fire related core melt frequencies were computed, and consequence analysis was done in a manner similar to that used for internal events.

b. Seabrook

Eight external events were considered: seismic, fires, aircraft accidents, wind, turbine missiles, internal floods, external floods, and hazardous chemicals. A limited bounding analysis was applied for some of the events to show, for the largest predicted sizes, that either no damage of concern would result or the frequency of damaging plant components which could lead to core melt would be negligible compared with that of other events. This bounding analysis eliminated from further consideration all external events except seismic, fires, and aircraft crashes. For these three, the following methodology was employed:

i. Seismic - The frequency of ground motion of various magnitudes was determined. The fragility of plant structures and components was determined by estimating the ground acceleration that would cause failure. A plant logic model was developed which related system failures (including nonseismic failures in conjunction with seismic failures) to core damage. These steps were combined to produce estimates of core melt frequency and related plant damage states. For the major seismic contributors, calculation of the probability distribution of plant damage state frequencies was completed.

ii. Aircraft Crash - Aircraft activity near the Seabrook site was examined, and crash rates at the site were estimated based on this activity and U.S. aircraft accident rates for the past 10 years. Fragilities for structures identified as potential targets at the site were estimated, and plant damage states were identified for various crash scenarios. From these estimates, the probability of a severe accident and the consequences from aircraft crashes at the site were calculated. The contribution to core melt probability and risk was found to be negligible.

iii. Fires - The fire analysis is based on the location of important cables and equipment previously assessed for the plant by the utility. The frequencies of fires were derived from data collected from all U.S. nuclear power plants. The impact of fires on instrumentation was analyzed explicitly for the cable spreading room and control room. A list of 11 fire zones judged to have the largest potential of plant damage from fire was developed. The frequencies and consequences of fire suppression efforts was considered. From these results, the contribution from fires to core melt probability and risk was estimated.

c. Shoreham

The only external event considered in the PRA was flooding of elevation 8 of the reactor building. This initiator was combined into the internal events category.

d. Oconee

Six external events were considered: seismic, tornado, fires, external floods, flooding events from sources within the plant, and aircraft impact. All remaining events in the external events list were eliminated from consideration by determining their inapplicability to the Oconee site. The aircraft impact initiator was eliminated by screening calculations which verified that their frequency of occurrence was too low to present an important contribution to core melt frequency or risk. For the external flood initiator, a detailed bounding analysis showed that failure of the Jocassee Dam contributed about 10% of the total core melt frequency. For the remaining four external initiators the following methodology was employed:

i. Seismic - The frequency of occurrence of ground motions of various magnitudes was evaluated to obtain the seismicity hazard. The capacities of important plant structures and equipment to withstand earthquakes were evaluated to determine the conditional probability of failure as a function of ground acceleration. The internal initiator fault tree and event tree models were modified to reflect plant response to seismic events and then solved to obtain Boolean expressions for the seismic event sequences. The Boolean expressions were quantified by using the probabilistic site seismicity and the fragilities for plant structures and equipment.

ii. Tornado - The frequency of occurrence of tornadoes with wind speed above 150 mph was evaluated from historical data in the area. A tornado event tree was constructed and quantified by using judgmental data for the tornado effects on systems and equipment.

iii. Fires - The analysis was limited to areas where the most damage could be anticipated. The frequencies of fires were derived from the experience of all U.S. nuclear power plants. Simple models were used to assess the propagation of fires in cable trays and the temperature rise in compartments due to fires. The analysis of the fire-initiated sequences was not detailed. It did not include the timing of events, the possibility of restoring lost functions, and the possibility of errors of commission.

iv. Internal Floods - The initial analysis of internal flooding was done by using a survey and overview technique. Flood sources and critical locations were identified. The frequency of flood initiating events was estimated from U.S. nuclear power plant experience combined with Oconee plant experience. Core melt sequences were constructed based on information obtained from the above efforts plus the understanding obtained from the analysis of the internal initiator sequences. The results indicated that turbine building flooding dominated the core melt frequency. In view of that, a refined analysis was carried out including detailed fault tree models for all turbine-building floods in order to obtain a more plant specific quantification of their frequencies. Since the turbine-building flooding continued to dominate the results, it was decided to make some plant modifications. Further evaluation of these sequences, including the modifications, were then performed.

5.2.22 Source Terms

Description	Levels of Effort
Characteristics of radionuclide release from accident sequence	Not applicable (not considered in NUREG/CR-3853)

a. Millstone

Fission product release to the containment was calculated by the MARCH/MODMESH/CORCON/COCOCLASS9 code package. The CORRAL-2 code was used to compute fission product fractions available for release from the containment. Some 30 CORRAL runs were made corresponding to plant damage states. These results were grouped into 13 release categories depending on similarities of timing and release magnitude. To account for fission product attentuations in the primary system and in the containment from physical mechanisms not considered in CORRAL, a discrete probability distribution method was used. In this method, the point estimate release estimates from CORRAL were multiplied by discrete factors of one or less with corresponding probabilities assigned to each factor. These factors and probabilities were derived by expert judgment applied to the separate transport and deposition stages.

b. Seabrook

Time-dependent releases calculated in the CORRAL-II code were used to define the point estimate release categories. Thirteen release categories were used based on containment failure mode, availability of sprays, and whether the reactor vessel cavity was assessed to be wet or dry. The MARCH, MODMESH, CORCON, and COCOCLASS9 codes were used to define thermal-hydraulic conditions in the primary system and containment. The discrete probability distribution approach was used to estimate factors (all 1.0 or less), and their probability, which were applied to the CORRAL-II point estimate results. These parameters were established by expert judgment.

c. Shoreham

The PRA employed the MARCH code to calculate system pressure, temperature, core-coolant interactions, and containment conditions for "binned"

groups of accident sequences. WASH-1400 assumptions and recent studies of releases from fuel were used to establish the inventory available, and the CORRAL code was used to calculate the effects of the transport and removal mechanisms on fraction of available inventory in each control volume of the containment and the total release to the atmosphere, and its composition, as a function of time.

D. Oconee

The CORRAL code (USNRC, 1975) was used to analyze the release and transport of radionuclides inside the containment. The radionuclide inventories and release mechanisms were taken from the RSS (WASH-1400) and altered as necessary to reflect new information concerning releases. Many sensitivity studies were performed to determine the effect of known uncertainties and varying assumptions. The entire spectrum of releases was then grouped into six release categories.

5.3 Comparison and Ranking of PRA Methodologies for the Four Plants

This section presents, in unified tabular form, the methodological characteristics of the four PRAs examined (Millstone 3, Seabrook, Shoreham, and Oconee), in the light of criteria defined in NUREG/CR-3852 (Table 5.1).

Several introductory remarks are in order, particularly in the light of the uncertainties and in some cases the lack of complete definition remarked on in the introduction above.

i. The treatment of certain topics was not uniform, one aspect being treated in one way (e.g., generically) while another was treated differently (e.g., plant specifically). In those cases the "level of effort" was described by a mixed notation, e.g., B/C or D/A.

ii. Only one of the plants under consideration (Oconee) is actually operational. In the other cases, the terminology "plant-specific" as applied to experiential data is moot. However, in many of these cases generic data have been combined with particularly relevant data from analogous plants and equipment. When this was done, the characterization of the treatment (level of effort) was "starred" (e.g., A*).

iii. No external event data were available for Shoreham.

iv. Related investigations regarding containment are, however, available for Shoreham, and for completeness they are stated here:

- The containment response was obtained by detailed specific analyses and numerical calculations.
- No special assumptions (such as steam explosions, etc.) were included.
- The ultimate external consequence analysis for Shoreham is not available at present.

120

Table 5.1 Comparison and Ranking of PRA Methodologies for Four Plants

	Topic Designator	Topic Description	Levels of Effort	Millstone	Seabrook	Shoreham	Oconee
1	IIE	Identification of initiating events	A WASH-1400 initiators used B WASH-1400 plus EPRI NP-801 used (generic data) C Generic data plus plant specific data	C	C	C	C
2	FIE	Frequency of initiating events	A Generic (for example from NP-801) B Generic plus classical use of plant specified data C Two stage Bayesian	C	B/C*	A*	C
3	ET	Event tree modeling characteristics	A Small systemic event trees B Large event trees including global human actions	B	B	A	A
4	AIE	Aggregation of initiating events	A Complete aggregation C Functional (phenomenological) aggregation E No or little aggregation	E	C	C	C
5	SDA	System hardwired dependency analysis	A Use of engineering judgment C Systematized hand analysis E Boolean reduction code used	1	1	C	E
6	SIA	System interaction analysis	A No analysis performed C Engineering insight D Plant walkthrough E FMEA plus plant walkthrough	C	2	C/D	E
7	PAHR	Treatment of the postaccident heat removal phase	A Standard (WASH-1400) accident length used (24 hours) B Realistic accident length based on sequence requirements D Realistic accident length and component recovery considered	D	D	D	D
8	HN	Human errors during normal operation	A Scoping human error analysis C Non-detailed human error analysis E Detailed human error analysis	E	E	C	E

Table 5.1 Continued

	Topic Designator	Topic Description	Levels of Effort	Millstone	Seabrook	Shoreham	Oconee
9	HA	Human errors during accident progression	A Scoping human error analysis C Non-detailed human error analysis E Detailed human error analysis	E	E	E	E
10	CM	Common mode human error analysis	A No analysis performed B Analysis performed on an inconsistent basis D Detailed consistent analysis performed	D	D	B	D
11	R	Treatment of recovery	A No recovery actions considered C Recovery of human errors and actuation faults considered D Recovery of human errors, actuation faults and individual component faults considered	D	D	D	D
12	AC	Modeling of ac power systems	A Previous study results used C Simple non-detailed models used E Detailed system models used	E	E	E	E
13	L	Modeling of logic systems	A Previous study results used C Simple non-detailed models used E Detailed system models used	E	E	E	E
14	CC	Common cause analysis	A No analysis performed B Analysis performed on components determined by engineering judgment C Detailed comprehensive analysis performed	C	C	B	B
15	DB	Data base used	A Generic C Generic plus classical plant specific E Plant specific, Bayesian	A	1	A*	E
16	DEP	Use of demand failure probabilities	A Use of generic demand failure probabilities for long test periods C Use of failure rates developed from DEP for long test periods	A	2	A	C
17	MVM	Use of mean vs use of medians	A Use of mean failure rates A Use of median failure rates	A	A	A	A

Table 5.1 Continued

	Topic Designator	Topic Description	Levels of Effort	Millstone	Seabrook	Shoreham	Oconee
18	SSC	Determination of system success criteria	A FSAR data used C Plant specific (realistic) analysis performed	C	2	C	C
19	TM	Modeling of test maintenance outages	A Generic data used B Generic data plus plant specific repair times used D Plant specific data used	B	B	A	B
20	EQ	Modeling equipment environmental qualification	A Do not consider B Use engineering judgment C Estimate environmental conditions at time of accident and use manufacturers' specifications for equipment	B	2	A	C
21A	EIE	External initiating events	A Not included B Generic events used C Some plant specific events used D Comprehensive data used	D	D		D
21B	FEE	Frequency of external initiators	A Generic data used B Regional data used C Plant specific (local) data used	C	C		C
21C	MEE	Methodology of external event treatment	A Engineering judgment B Screening only C Screening plus detailed evaluation D Quantitative formalism	C	C		B/D
22	ST	Source term	A WASH-1400 B ANS C WASH-1400 plus refinements D Specific calculations	C	C	C	C

1 - None of defined levels of effort define methodology. See Section 5.2 for details.
2 - Could not be determined.

6. SUMMARY

This section is intended to highlight the insights derived from the study. The PRA-specific insights with respect to initiators, failure modes, system failures and component failures are included in Sections 1 through 4 and, with few exceptions, will not be repeated here. The "generic" insights derived from the study are presented with the note that it was difficult to glean numerous "generic" insights from only four PRAs, representing three different reactor types, although this in itself may be an insight.

The following are the insights bounded by the above discussion:

- All four PRAs were conducted with numerous refinements over the WASH-1400 effort and have yielded more realistic results.

- The core melt probabilities due to internal events are identical (within error bounds) for three of the plants, and that for the fourth (Seabrook) is relatively close.

- With the possible exception of the low pressure service water system initiator at Oconee, none of the PRAs shows any internal events to be "outliers."

- The dominant risk sequences represent only a small fraction (typically less than 1%) of the total contribution to CMP and are characterized by loss of the containment function due to direct bypass or overpressurization.

- In the two PRAs (Millstone and Seabrook) which specifically documented risk contribution by sequence; interfacing systems LOCA represent over 98% of the total contribution to early fatalities. Although not specifically quantified, the Shoreham PRA appears to identify large LOCA with early suppression pool failure as its leading contributor to early fatalities.

- The CMP and risk associated with the interfacing systems LOCA (event V), as demonstrated by the Oconee PRA, can be substantially reduced by appropriate selection of operating configuration, testing procedures,

- The leading contributors to latent fatalities would appear to be interfacing systems LOCA, large LOCA with early containment failure, station blackout greater than six hours and RCP seal LOCA.

- The Shoreham PRA insights listed in Section 3 are driven to a large extent by one major assumption within the PRA. The PRA has adopted a generic failure to scram probability from NUREG-0460 and assumes the common mode failure of the control rods to insert as the only contributor. The PRA states that a Shoreham-specific analysis was done and that the results were on the order of 25% lower than the NUREG, but were not used in the study. Had these results been used, the CMP as well as the dominant sequences, failure modes, system failures, and component failures as presented in this report would all be changed.

- The different plant PRAs showed wide variance as to what internal accident initiators dominated the CMP. For Shoreham (BWR), ATWS dominated and LOCAs were insignificant. For Oconee, LOCAs contributed approximately 30% of the CMP and large LOCA contribution was 1.5 times that of small LOCA. Even the results for the two Westinghouse plants (Seabrook and Millstone) were considerably different from one another. Seabrook and Millstone both found small LOCA greater than large LOCA in terms of contribution to CMP, but small LOCA contribution was 11% in Seabrook and 24% in Millstone.

- The core melt probability (CMP) and the percentage contribution from internal and external initiators are shown below for the four PRAs analyzed.

Plant	Total Core Melt Probability (CMP)	Contribution from Internal Initiators (%)	Contribution from External Initiators (%)
Millstone	5.89E-05	76.4	23.6
Seabrook	2.30E-04	80.0	20.0
Oconee	2.54E-04	21.3	78.7
Shoreham	5.50E-05	100.0	*

*The study did not consider external events.

The main insight drawn from these results is that the usual breakdown of percentage contribution by internal versus external initiators of about 80/20 was fully reversed in the Oconee study. The Oconee results are for the modified plant; the external initiator dominance (mainly internal floods) was even more dominant in the original plant.

Appendix A

DETERMINATION OF LATENT FATALITY RISK (AT >1000 FATALITIES) CONTRIBUTION FOR SEABROOK

This appendix describes the procedure used in deriving accident sequence contributions to latent fatalities from external events, based on the Seabrook SSPSA results. The SSPSA does not provide information from which these contributions can be directly obtained, but the results provided are detailed enough to allow estimation of the contributions by combining appropriate factors.

The SSPSA latent fatalities are computed from source terms associated with release categories defining the necessary radionuclide release parameters. Each release category is made up of plant damage states having similar characteristics relative to the disposition of radionuclides. Each plant damage state consists of accident sequences grouped into the damage states on the basis of similar outcomes regarding the end state of the plant following the assumed sequence. The SSPSA provides the relative contributions of leading accident sequences to plant damage states, the relative contribution of plant damage states to release categories, and the relative release category contribution to latentfatality risks. By extraction of appropriate contributions from each of these steps, the relative significance of individual accident sequences (or groups of sequences) to latent fatality risk can be estimated.

The first step in the procedure was to determine the relative contribution of the various release categories to latent fatality risk. This information is given in Table A.1 (extracted from Table 13.2-7b of the SSPSA). The last column shows the contribution from the release categories averaged over the 1,000 and 10,000 fatality levels. To be consistent with othe estimates in this report, the level above 1,000 fatalities was chosen as the risk parameter. The 100,000 level was neglected because of its extremely low probability. This averaging is a crude estimate, but is considered valid because the release category contributions for 1,000 and 10,000 are similar, as shown in Table A.1; within 5% of the average in all cases but one (S6V), for which the average is 13% from the two contributions.

After establishing the contribution from each release category to the latent fatality risk, the next step was to determine the plant damage state contribution to each release category. This information (from Table 13.2-8 of the SSPSA) is given in Table A.2 for the four release categories of interest. The plant damage states (7FP, etc.) identify certain plant accident conditions which result in particular release categories.

The next step in the procedure was to examine the accident sequences which are the leading contributors to each plant damage state to determine common features, including which sequences are initiated by external events and their relative significance. This information is found in SSPSA Tables 13.2-13c through 13.2-13l. By examining these sequences, and grouping them appropriately, Table A.3 was formulated. It includes only those plant damage states which had significant contributors (more than a few percent) from accident sequences initiated by external events.

From the information in Tables A-1, A-2, and A-3, the contribution to latent fatalities from accident sequences initiated by external events can be readily obtained. For example, for seismic events causing loss of off-site power and containment isolation failure (<3"), the product of the contribution of these accidents to plant damage state 7FP (90%) and the contribution of 7FP to release category S2V (60.6%), and the contribution of S2V to the latent fatality risk (48%) are computed. Similarly, all accident groupings in Table A-3 are computed. The result is given in Table 2.11 of the main report.

Table A.1 Contribution of Release Categories to Risk of Latent Cancer Fatalities for Seabrook

Release Category	% Contribution		Average
	1000 Fatalities	10000 Fatalities	
S2V	51.2	44.8	48
S6V	11.9	35.5	23.7
S3	15.9	9.55	12.7
S3V	17.1	7.65	12.4
Totals	96.1	97.5	96.8

Table A.2 Contribution of Release Categories to Plant Damage States

Release Category	% Contribution to Damage States									
	7FP	3FP	1FP	8D	4D	1F	3F	7F	7D	3D
S2V	60.6	34.6	4.75							
S6V						77.6	20.5	1.46		
S3				94.4	4.8					
S3V									78.3	21.4

Table A.3 Contribution of External Events to Seabrook Plant Damage States

Plant Damage State	Seismic, LSOP Containment Isolation Failure (<3")	Seismic, Solid State Protection Failure, Fire, Loss of Containment Cooling	Containment Isolation Failure (>3")	Seismic, LOSP Containment Isolation Failure (>3")
7FP	90			
3FP	85			
8D		30		
3F			32	46

FORM 335 U.S. NUCLEAR REGULATORY COMMISSION
1102
3202

BIBLIOGRAPHIC DATA SHEET

INSTRUCTIONS ON THE REVERSE

1 REPORT NUMBER (Assigned by TIDC, add Vol. No., if any)
NUREG/CR-4405
BNL-NUREG-51931

2 LEAVE BLANK

TLE AND SUBTITLE
robabilistic Risk Assessment (PRA) Insights

4 DATE REPORT COMPLETED
MONTH: April
YEAR: 1986

THOR(S)
. Fitzpatrick, L. Arrieta, T. Teichmann, P. Davis

6 DATE REPORT ISSUED
MONTH: December
YEAR: 1987

RFORMING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code)
rookhaven National Laboratory
pton, New York 11973

8 PROJECT/TASK/WORK UNIT NUMBER

9 FIN OR GRANT NUMBER
A3796

PONSORING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code)
ivision of Safety Review and Oversight
ffice of Nuclear Reactor Regulation
.S. Nuclear Regulatory Commission
ashington, DC 20555

11a TYPE OF REPORT

b PERIOD COVERED (Inclusive dates)

SUPPLEMENTARY NOTES

ABSTRACT (200 words or less)

Four different probabilistic risk assessments (PRAs) have been briefly reviewed ith the broad objective of ascertaining what insights might be gained (beyond those lready documented in the PRAs) by an independent evaluation. This effort was not ntended to verify the specific details and results of each PRA but rather, having ccepted the results, to see what they might mean on a plant-specific and/or generic evel. The four PRAs evaluated were those for Millstone 3, Seabrook, Shoreham, and conee 3. Full detailed reviews of each of these four PRAs have been commissioned by he NRC, but only two have been completed and available as further input to this study: he review of Millstone 3 by LLNL and the review of Shoreham by BNL.

The review reported here focused on identifying the dominant (leading) initiators, ailure modes, plant systems, and specific components that affect the overall core melt robability and/or risk to the public. In addition, the various elements of the ethodologies employed by the four PRAs are discussed and ranked (per NUREG/CR-3852). RA-specific insights are presented within the report section addressing that PRA, and verall insights are presented in the Summary.

DOCUMENT ANALYSIS - a KEYWORDS/DESCRIPTORS

Probabilistic risk assessment
Insights
Millstone
Seabrook
Shoreham
Oconee

IDENTIFIERS/OPEN-ENDED TERMS

15 AVAILABILITY STATEMENT
Unlimited

16 SECURITY CLASSIFICATION
(This page) Unclassified
(This report) Unclassified

17 NUMBER OF PAGES

18 PRICE

BEST COPY AVAILABLE

* U. S. GOVERNMENT PRINTING OFFICE: 1988-202-292:60326

UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555

OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE $300

SPECIAL FOURTH CLASS RATE
POSTAGE & FEES PAID
USNRC
PERMIT No. G-67

130